


**Town of Greenville
Standard Specifications
For:**

**Sanitary Sewer
Water Main
Storm Sewer
Roadway and Lot Line
Construction**

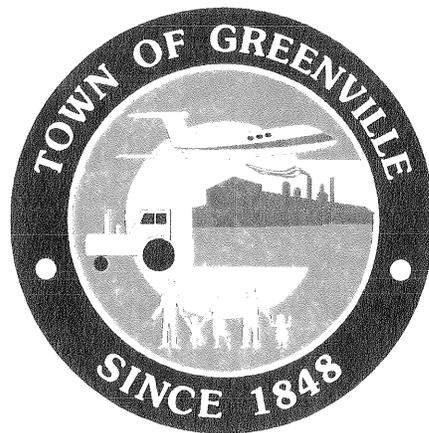

Michael S. Siewert, P.E.
Revised December 4, 2008
Adopted December 8, 2008
M&E Proj. Number 156-905 DR

Table of Contents

Town of Greenville Standard Specifications

General

Section	Page
A. Standard Specifications	1
B. Scheduling.....	1

Sanitary Sewer

Section	Page
A. Approved Materials	1
B. Installation	2
C. Sanitary Sewer Testing	2
D. Observations & Record Drawings	2

Water Main

Section	Page
A. Approved Materials	3
B. Installation	3
C. Depth of Cover.....	4

Storm Sewer

Section	Page
A. Approved Materials	4
B. Installation	5

Roadway and Lot Line Construction

Section	Page
A. Inspections Required.....	5
B. Construction Schedules	6

Construction Acceptance Checklist

Detail Drawings

S.1	Typical Connection Sewer & Water
S.2	Riser

- S.3 Standard Precast Sanitary Manhole
- S.4 Standard Precast Drop Manhole
- S.5 Inside Drop Manhole
- S.6 Standard Valve & Valve Box Setting
- S.7 Megalug & Blocking for Bends
- S.8 Blocking for Plugs
- S.9 Megalug & Blocking for Tees
- S.10 Hydrant Detail
- S.11 Storm Sewer Manhole
- S.12 2'x3' Inlet Detail
- S.13 HDPE Yard Drain
- S.14 Curb & Gutter Details
- S.15 Typical Trail Ramp
- S.16 Typical Street Section (66'R.O.W.) Rural – Local
- S.17 Typical Street Section (80'R.O.W.) Rural – Collector
- S.18 Typical Street Section (66'R.O.W.) Urban – Local
- S.19 Typical Street Section (80'R.O.W.) Urban – Collector
- S.20 Pulverized Road Detail
- S.21 Inlet Protection, Type A
- S.22 Sock and Silt Fence – Installation Detail
- S.23 Pond Detail
- S.24 Utility Trench Repair Detail
- S.25 Nonstandard Signs Installation Details
- S.26 Low Speed Curve
- S.27 Traffic Circle Installation Detail
- S.28 Traffic Circle Signage
- S.29 Median Island Installation Details and Signage (Option 1)
- S.30 Median Island Installation Details and Signage (Option 1) at Intersections
- S.31 Median Island Installation Details and Signage (Option 2)
- S.32 Roundabout Installation Details
- S.33 Roundabout Marking and Signage
- S.34 Typical Lateral Shift Installation Details and Signage
- S.35 Speed Hump Installation Details
- S.36 Raised Crosswalk Installation Details
- S.37 Spacing of Traffic Calming Devices
- S.38 Mail Box Cluster Detail for Cul-de-Sacs

General

A. Standard Specifications

1. For sewer and water construction, the Town of Greenville standard specification shall be the “Standard Specifications for Sewer and Water Construction in Wisconsin”, Latest Edition.
2. For street construction, the Town of Greenville standard specification shall be the “State of Wisconsin Standard Specifications for Highway and Structure Construction” Latest Edition.
3. For traffic control, the control methods shall conform to the Manual on Uniform Traffic Control Devices, including all supplements.
4. For storm water the standard specifications shall be WDNR Storm Water Management Technical Standards.

B. Scheduling

1. Once the sewer, water, and storm sewer construction is complete, the Utility Contractor shall schedule a walk through with the Sanitary District, the Town Engineer, and the Developer’s Engineer. The Utility Contractor shall correct any deficiencies prior to the Street Contractor commencing work.
2. Once the street is complete through gravel, the Street Contractor shall schedule a walk through with the Sanitary District, the Utility Contractor, the Town Engineer, and the Developer’s Engineer. Dependent upon responsibility, the Contractors shall correct any deficiencies prior to accepting the work.
3. Typically the Town requires the graveled street to go through one freeze/thaw cycle prior to placing curb and gutter and binder pavement. The timing of the placement of the curb and gutter and binder pavement is solely up to the discretion of the Town of Greenville.
4. Upon 60% build out the Developer is typically required to place the final pavement. The timing of the placement of the finish pavement is solely up to the discretion of the Town of Greenville.

Sanitary Sewer

A. Approved Materials

1. PVC Sewer Laterals 4" - 6" SCH-40 ASTM D 2665 or smaller
2. PVC SDR 35 – Sewer Main meeting ASTM D-3034 and F-789/PS46 for 4" - 15" or smaller
3. PVC SDR34– Sewer Main meeting ASTM F769 or F-794 For 18”-48”
4. Manholes - Precast Concrete - ASTM C-478; Integral base with precast inverts, the inverts shall be epoxy lined; rubber gasket joint ASTM C-443 or Kent-Seal

5. Castings - Neenah Foundry R-1550 with self-sealing Type "B" lid with concealed pick hole. Castings shall be R-1916-C bolt down in areas deemed to be susceptible to flooding.
6. Manhole Chimney Seal - Cretex internal manhole chimney seals are required in all new sanitary manholes or an equal approved by the Town.
7. Kent Seal butyl rubber sealant shall be 1-1/4" wide between barrel sections and 3/4" wide between adjustment rings and the casting and between the adjustment rings.
- 8.

B. Installation

1. On mains with a depth of twelve (12) feet or greater, laterals shall be installed with a riser to facilitate a depth at the property line of ten (10) feet.
2. Depth of laterals at the property line shall be determined by the Utility District Manager or representative prior to installation.
3. At all manholes, 3/4-inch crusher run stone shall be installed from the top of the cone to the top of the casting.
4. For existing roadway crossings, backfill will be native material mechanically compacted in one (1) foot lifts if material is acceptable to Town Public Works Supervisor.
5. Manhole castings shall be tilted to match the slope of the road.
6. For new construction, manhole castings shall be set at gravel grade.
7. Where utilities are planned to be placed in an easement on the street side of the lot, the sewer lateral shall extend ten (10) feet beyond the right of way.
8. For new construction, the required chimney seals shall be delivered to the Town Garage for installation by Town employees after paving.
9. For new construction, a minimum of two (2) inches of rings to a maximum of eight (8) inches of rings shall be placed on the cone. Under no conditions shall there be more than ten (10) inches of rings placed on the cone without the approval of the Utility Superintendent.
10. Pipe lengths entering and exiting manholes shall be no shorter than 10 feet.
11. All sewers over twenty feet deep shall use SDR 26 pipe material.
12. All laterals shall have tracer wires from the main to the building.

C. Sanitary Sewer Testing

1. All new sanitary sewer installations shall be tested per the standard specifications and shall be cleaned, pressure tested and televised. A complete written report of the televising shall be prepared for review by the Sanitary District. The report shall include photographs, and color video tapes (VHS) or DVD, and shall be enclosed in a binder. The report shall be approved by the Sanitary District before the overall project will be accepted.

D. Observations & Record Drawings

1. All sanitary sewer, water main, and storm sewer construction projects will be inspected by Martenson and Eisele, Inc., unless otherwise specified. All record drawings will be prepared by Martenson and Eisele, Inc. The engineering firm preparing the plans for the construction phase, shall submit a complete reproducible plan and electronic CAD file to the Greenville Sanitary District no later than fifteen (15) days after the project proceeds. The Contractor shall work with the inspector to provide locations and elevations of all structures including but not limited to manholes, inlets, hydrants, valves and curb stops. All record drawing information shall be submitted in AUTO-CAD format and shall be on the Outagamie County coordinate system.

Water Main

A. Approved Materials

1. PVC – Main AWWA C900, DR 18 6" - 10"; Rubber Gaskets ASTM D-1869
2. Fittings - Ductile - ANSI A21.10 and AWWA C-153
 - a. ANSI A21.11 and AWWA C111
 - b. Cement Lined
 - c. All Mechanical Joints shall have "Cor-Blue" bolts
 - d. All Reducers shall be concentric
3. Valves - AWWA C509-80 Waterous with stainless steel bolts
 - a. Resilient-seated gate valves - 200 psi with valve box adaptor
 - b. Screw type valve box, 5-1/4" length to suit depth
4. Service Pipe – 1-1/4" 200 psi CTS SDR9 - ASTM D-2737
5. Corporation - A.Y. McDonald A4701B-22 (ball valve - type)
6. Curb Stop - A.Y. McDonald 6100-22
7. Curb Box - A.Y. McDonald 5607 for 6'-6" bury and 48" stainless steel rod
8. Tapping Saddles - Cascade CSC-2 Double bolt stainless steel
9. Fire Hydrants - Waterous Pacer WB-67 with Traffic Flange and "Cor-Blue" bolts; Flexi-Flags shall be installed on all hydrants
10. All Water Main Fittings throughout the Project shall be installed by the Contractor to include Megalugs (minimum one (1) per MJ joint)
11. All fittings, valves, valve boxes, curb boxes shall be wrapped with Poly Wrap
12. All Valves shall have valve box adaptors.

B. Installation

1. Backfill Material
 - a. In new developments, backfill material may be native if material is acceptable to Town Street Superintendent. Otherwise, backfill material under future pavement shall be special backfill.

- b. In existing developments, backfill shall be per Standard Specifications.
- c. For existing roadway crossings, backfill will be native material mechanically compacted in one (1) foot lifts if material is acceptable to Town Street Superintendent.
2. Where utilities are planned to be placed on the street side of the lot the water lateral shall extend ten (10) feet beyond the right of way. The curb stop shall still be placed at the right-of-way.
3. Where water main changes direction by 90° a minimum of two 45°bends shall be used.

C. Depth of Cover

1. Typical minimum 7-feet.
2. In areas with no proposed finish grade is provided, the minimum shall be 8-feet below existing grade.
3. Bedding Material shall be screenings.
4. Hydrants
 - a. Place 8.0 mil polyethylene bag over hydrants until acceptance by the Greenville Sanitary District #1.
 - b. Pump hydrant barrels dry prior to acceptance of project.
 - c. The Contractor shall install a plastic coated #10 AWG copper wire with all PVC water pipe. The wire shall be securely attached to the pipe a minimum of three times for each pipe length. The wire shall be grounded to all valves, fittings, and hydrants. Prior to final acceptance, the Contractor shall field verify actual installation by tracing for Owner.
 - d. Clear stone shall be placed around base of hydrant
5. Tracer wire shall also be placed along laterals with the terminus placed along side of the curb stop.
6. Hydrant placement off of property line will be determined on a case by case basis.

Storm Sewer

A. Approved Materials

1. Storm Sewer Main
 - a. Polyvinyl Chloride (PVC) SDR 35
 - b. Type PS46 Polyvinyl Chloride (PVC)
 - c. Polyvinyl Chloride (PVC) Ribbed Sewer Pipe
 - d. Polyvinyl Chloride (PVC) Corrugated Sewer Pipe
 - e. High Density Polyethylene (HDPE) Corrugated Pipe
 - f. Corrugated Metal Pipe
 - g. Reinforced Concrete Pipe
2. Storm Sewer Laterals

- a. Polyvinyl Chloride (PVC) SDR 35 or Schedule 40
3. Inlets
 - a. All inlets shall be precast inlets unless otherwise authorized by the Sanitary District
 - b. Inlet castings shall be Neenah Foundry R-3039-A for mountable curb and R-3067 for Standard curb installed per the detail drawing.
 - c. Vane grate castings shall be used for inlets not placed at low points in the road and shall be oriented to accept the flow.
4. Manholes
 - a. Manhole castings shall be Neenah Foundry R-1550 with non rocking Type "B" lid.

B. Installation

1. Depth of Cover Limitations
 - a. In areas under roadways with less than three (3) feet of cover over the pipe the pipe material must be RCP Class III or greater for pipes 12" in diameter or greater.
 - b. In areas under roadways with less than two (2) feet of cover over the pipe the pipe material must be RCP Class IV or greater for pipes 12" in diameter or greater.
 - c. For 8" pipe main and lateral which has between two (2) and three (3) feet of cover the pipe material must be PVC – Schedule 40 or AWWA C900.
 - d. No 8" pipe will be allowed with less than two (2) feet of cover i.e. 12" concrete shall be substituted.
 - e. The top of pipe will not be allowed to protrude into crushed aggregate base course.
2. All storm sewer connections shall meet spring line to spring line where practicable.
3. For existing roadway crossings, backfill will be native material mechanically compacted in one (1) foot lifts if material is acceptable to Town Street Superintendent
4. At all manholes, 3/4-inch crusher run stone shall be installed from the top of the cone (or flat top) to the top of the casting.
5. Inlet leads shall be twelve (12) inch. For inlet leads serving four or more inlets, the lead must be designed by an engineer.
6. For new construction, inlets and manholes shall be placed at gravel grade and shall be tipped to match the slope of the road.
7. For new construction a minimum of two (2) inches of rings to a maximum of eight (8) inches of rings shall be placed on the cone. Under no conditions shall there be more than ten (10) inches of rings placed on the cone or inlet without the approval of the Sanitary District.

Roadway and Lot Line Construction

A. Inspections Required

1. When roadway subgrade and/or the lot lines are completed to the appropriate elevation, the Town Engineer shall be notified. The Town Engineer will shoot the grades and inform the Contractor of any necessary corrections. The Town Engineer shall then witness a proof roll with a loaded dump truck and inform the Contractor of any necessary corrections. Upon Town Engineer's approval, Fabric and crushed aggregate base course may be placed.
2. Failure to comply with inspection requirements may result in the Town of Greenville not accepting the roadway and or the lot line grading.
3. Prior to graveling, a gradation report, from a state certified pit, must be submitted to the Town to verify that the gravel conforms to the specifications. If the gravel does not come from a state certified pit, a gradation report must be submitted to verify that the gravel conforms to the specifications.
4. When the graveling is completed to the appropriate elevation, it shall be shot by the Town Engineer. The Town Engineer will inform the Contractor of any necessary corrections.
5. All drainage ways shall have an eight (8) foot wide straw erosion mat placed in the bottom of the drainage way after seeding. All slopes greater than 5:1 shall also be matted. Erosion Mat shall be "Landlok BonTerra S2" or equal.
6. For curb and gutter, expansion joints shall be placed every 300' feet and at curve PC's and PT's per the standard specifications. All hot mixed asphalt for new roads in the Town shall be E-1. A job mix design must be submitted to the Town to verify that the mix conforms to the Specifications.

B. Construction Schedules




1. Graveling may not be performed between November 15th and May 1st of the succeeding year without prior approval of the Town of Greenville.
2. Asphaltic concrete pavement, concrete pavement, and concrete curb and gutter may not be constructed between October 15th and May 1st of the succeeding year without prior approval of the Town of Greenville. Under no circumstances shall gravel, curb and gutter, or asphaltic pavement be placed on frozen subgrade.

End of Section

**Town of Greenville
Construction Acceptance Checklist**

Project Name	
Date	
Project Number	
Developer	
Contractor	
Developer's Engineer	

Checklist Item	Complete	Pending (Explain)
1. Construction Complete		
2. Testing Complete		
a. Sanitary Sewer		
b. Water Main		
3. Walk Thru & Valve Check		
4. Final Punch List Completed		
5. Sewer Cleaned and Video Taped		
a. Report and Video Reviewed		
6. Safe Water Sample Received		
7. Record Drawing Okayed		
8. Received Six (6) Sets of Prints		
9. System Maps Updated		
10. Final Quantities & Costs		
11. Easements/Agreements Recorded (if any)		
12. Subgrade Shot and Approved		
13. Gravel Grade Shot and Approved		
14. Drainageways Shot and Approved		
15. Terraces Seeded and Mulched		
16. Final Walk Through Completed		
17. Lien Waivers Received		
18. Mail Box Cluster Installed		
19. Letter Recommendation Town Engineer		
20. Date Town Commission Action		
a. Conditional Approval		
b. Final Approval		

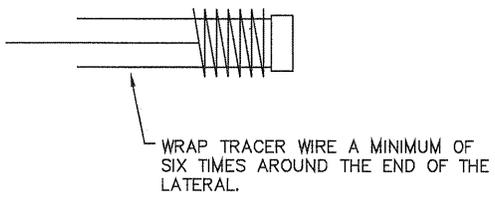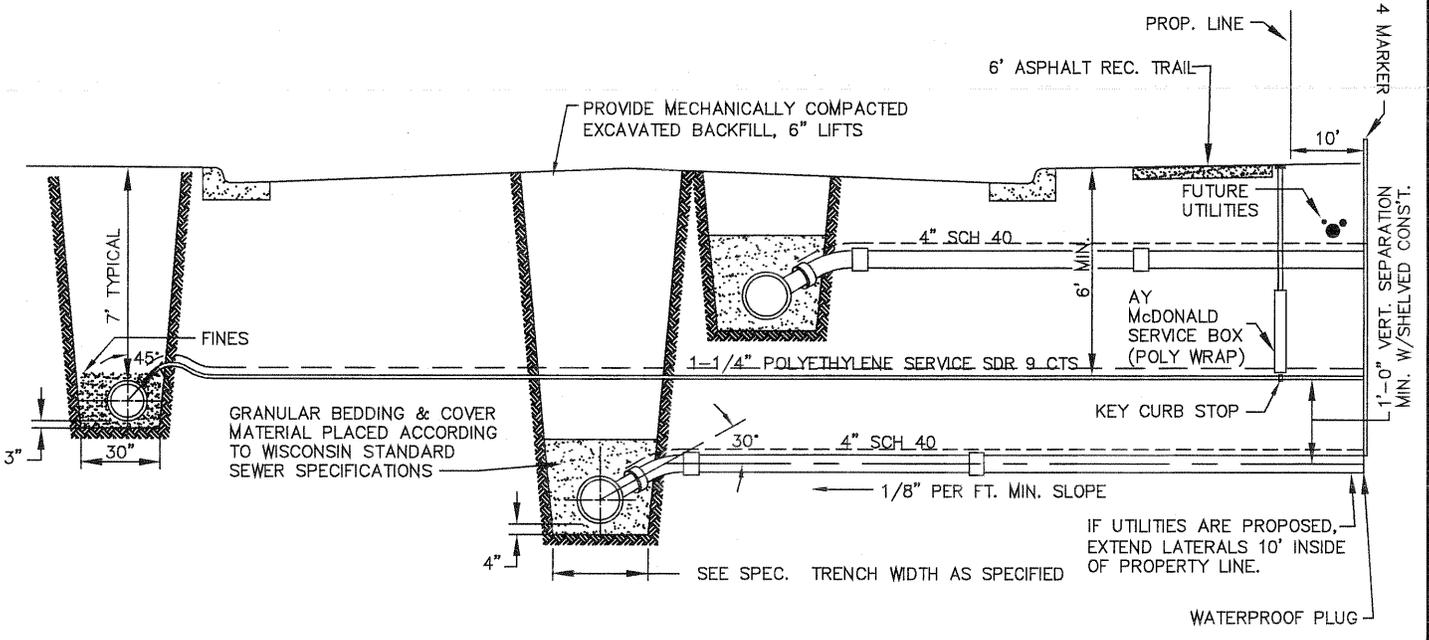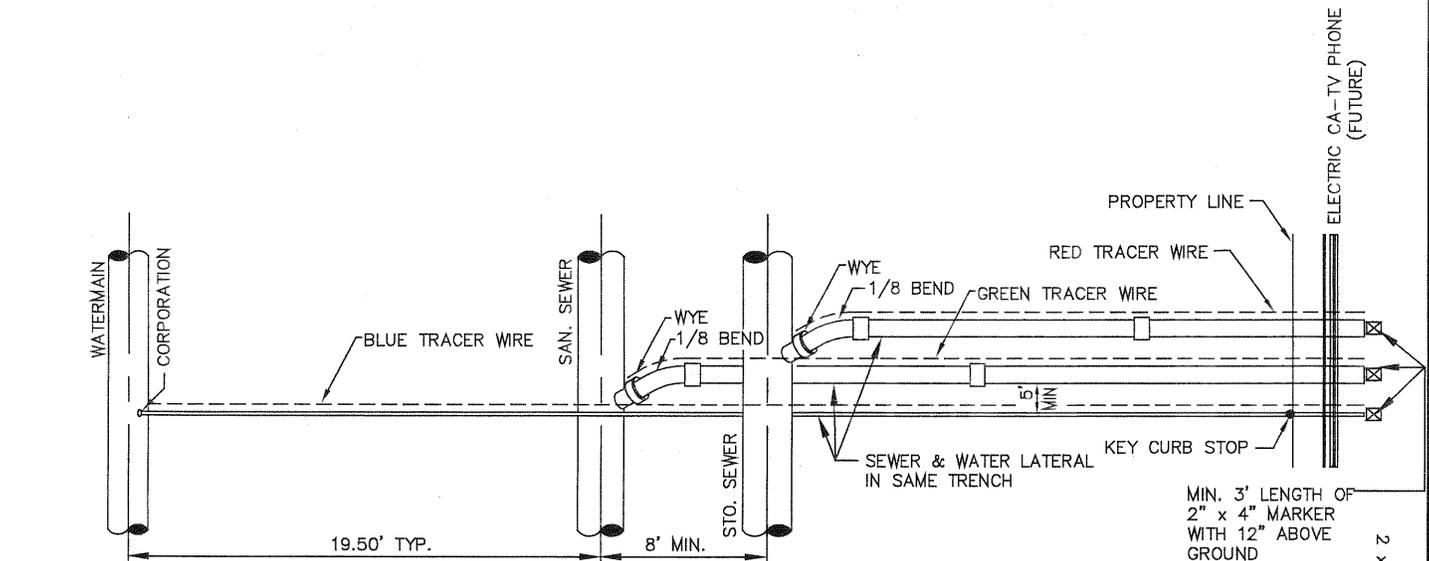

WIRE TERMINOUS DETAIL

S.1

Martenson & Eisele, Inc.




1377 Midway Road
 Menasha, WI 54952
 www.martenson-eisele.com
 info@martenson-eisele.com
 920.731.0381 1.800.236.0381

Planning
 Environmental
 Surveying
 Engineering
 Architecture

TYPICAL CONNECTION SEWER & WATER LATERAL DETAIL

FIELD BK	PAGE	NO.	DRAWN BY EAE	DATE	CHECKED	APPROVED	DRAWING NO.
SCALE N.T.S.	DATE 2-2-06				REVISION		
COMPUTER FILE \\156905d\drawings\ LATERALS.DWG							

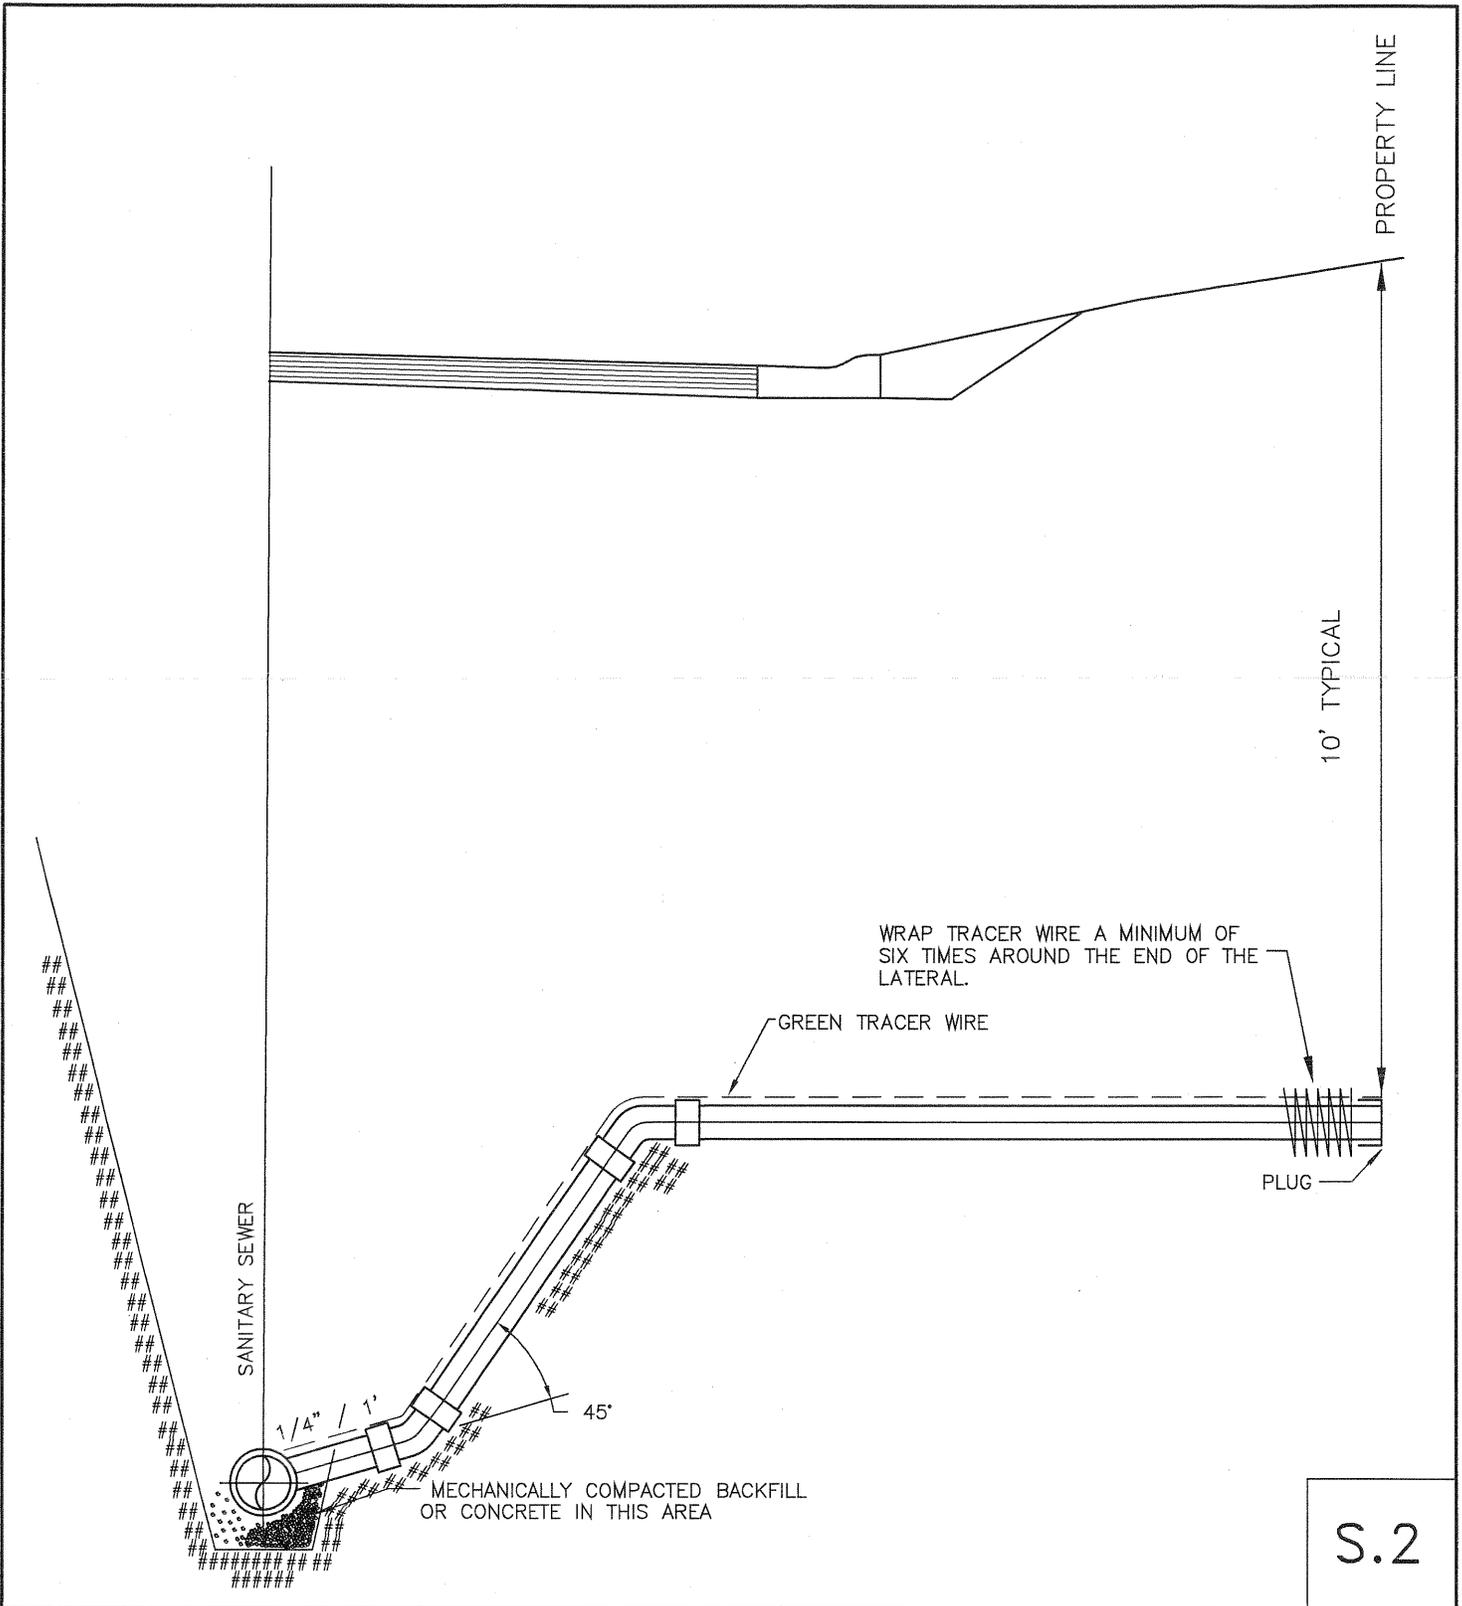

S.2

Martenson & Eisele, Inc.



1377 Midway Road
 Menasha, WI 54952
 www.martenson-eisele.com
 info@martenson-eisele.com
 920.731.0381 1.800.236.0381


Planning
 Environmental
 Surveying
 Engineering
 Architecture

RISER

FIELD BK	PAGE	DRAWN BY EAE	CHECKED	APPROVED	DRAWING NO.
SCALE N.T.S.	DATE 2-2-06	NO.	DATE	REVISION	
COMPUTER FILE					
1156905d\Drawings\					
RISERATMAIN.DWG					

ROUND ALL BOTTOMS SLOPE
INVERT OF INCOMING LINES
TO MEET INVERT OF MAIN

ALL FLOW LINES SHALL BE
SMOOTH AND FREE OF
DEFORMITIES

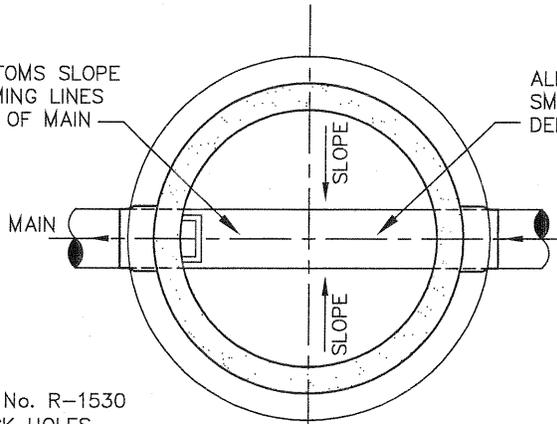

LID & FRAME NEENAH FOUNDRY No. R-1530
W/TYPE "B" LID, CONCEALED PICK HOLES
W/SELF-SEALING APPLICATION

8" MAX. HEIGHT ADJUSTING RINGS W/ MIN
ADJ. RING THICKNESS OF 2" W/WATERSTOP
(PREMOLDED) PLASTIC MASTIC-KENT SEAL
No. 2 OR EQUAL (TYP). SET AT 2" BELOW
FINISHED GRADE

CHIMNEY SEAL REQUIRED
CRETEX OR EQUAL

TAPERED RUBBER RING TO MATCH
SLOPE OF ROAD

BUTYL JOINT SEALANT REQUIRED

M.H. STEPS 16" O/C M.A. INDUSTRIES PSI,
NEENAH FOUNDRY No. R-1981-C (OR EQUAL.)

ECCENTRIC CONE

PRECAST M.H. SECTIONS

5" 4' IDIA. TYPICAL 5"

BUTYL JOINT SEALANT REQUIRED

10' MIN.

10' MIN.

FLEXIBLE RUBBER BOOT
PIPE TO M.H. CONNECTION

BOTTOM SLAB CAST
INTEGRALLY W/BOTTOM
SECTION BY MANUFACTURER

6"

ADJUSTMENT OF CASTING SHALL USE
LEAST AMOUNT OF RINGS POSSIBLE

S.3

Martenson & Eisele, Inc.




1377 Midway Road
Menasha, WI 54952
www.martenson-eisele.com
info@martenson-eisele.com
920.731.0381 1.800.236.0381

Planning
Environmental
Surveying
Engineering
Architecture


STANDARD PRECAST SANITARY MANHOLE

FIELD BK	PAGE	DRAWN BY EAE	CHECKED	APPROVED	DRAWING NO.
SCALE N.T.S.	DATE 2-2-06	NO.	DATE	REVISION	
COMPUTER FILE					
1156905drdwg					
SANITARY M.H.DWG					

ROUND ALL BOTTOMS
SLOPE INVERT OF
INCOMING LINES TO
MEET INVERT OF MAIN

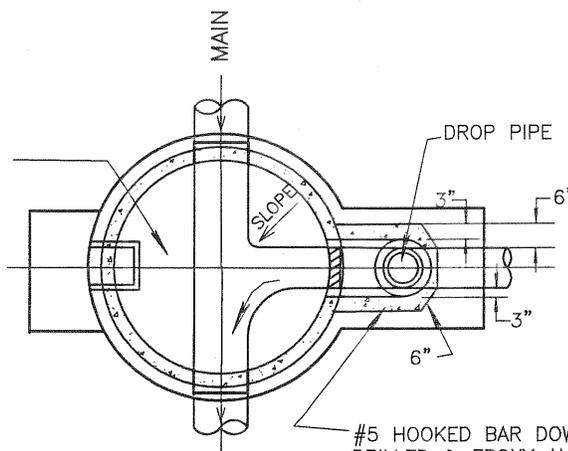

DOWEL DETAIL



#5 HOOKED BAR DOWELS @ 24" O.C.
DRILLED & EPOXY ANCHORED INTO
PRECAST MANHOLE (C-100 EPOXY
DOWELING SYSTEM BY HILTI OR
APPROVED EQUIV.) EMBED MIN. 3"

LID & FRAME NEENAH FOUNDRY
NO. R-1550 W/TYPE "B" LID,
W/SELF-SEALING APPLICATION.

2" MIN. 8" MAX. ADJUSTING RINGS
w/WATERSTOP (PREMOLDED) PLASTIC
MASTIC-KENT SEAL No. 2
OR EQUAL (TYP.)


M.H. STEPS 16" O/C M.A.
INDUSTRIES PSI. NEENAH
FOUNDRY NO. R-1981-C
OR EQUAL

PRECAST M.H. SECTIONS

RUBBER GASKET JOINTS

FLEXIBLE RUBBER BOOT
PIPE TO M.H. CONNECTION

BOTTOM SLAB CAST
INTEGRALLY W/BOTTOM
SECTION BY MANUFACTURER

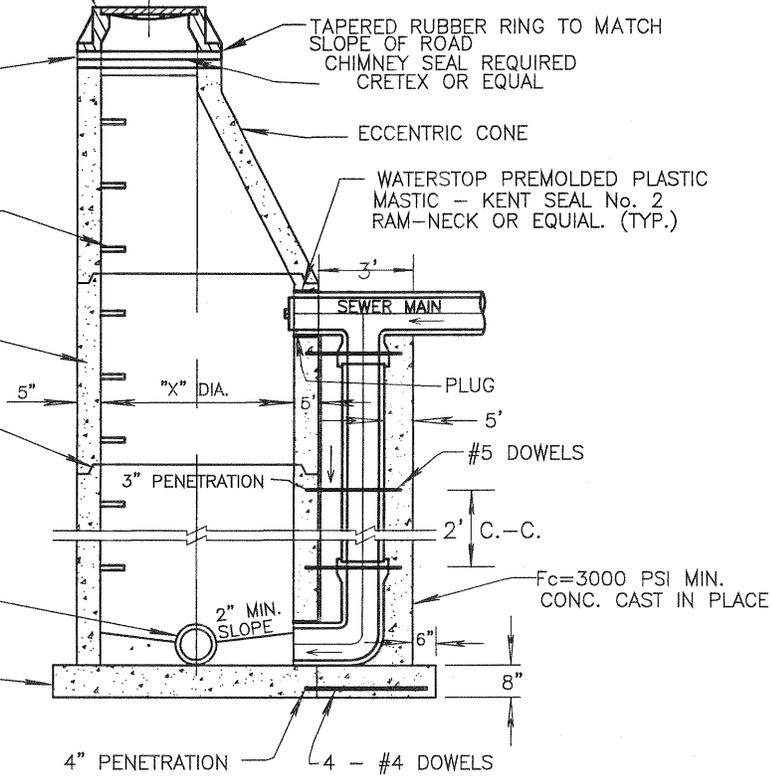

TAPERED RUBBER RING TO MATCH
SLOPE OF ROAD
CHIMNEY SEAL REQUIRED
CRETEX OR EQUAL

ECCENTRIC CONE

WATERSTOP PREMOLDED PLASTIC
MASTIC - KENT SEAL No. 2
RAM-NECK OR EQUAL. (TYP.)

SEWER MAIN

PLUG

#5 DOWELS

2' C.-C.

F_c=3000 PSI MIN.
CONC. CAST IN PLACE

4" PENETRATION 4 - #4 DOWELS

S.4

Martenson & Eisele, Inc.




1377 Midway Road
Menasha, WI 54952
www.martenson-eisele.com
info@martenson-eisele.com
920.731.0381 1.800.236.0381

Planning
Environmental
Surveying
Engineering
Architecture

STANDARD PRECAST DROP MANHOLE

FIELD BK	PAGE	DRAWN BY EAE	CHECKED	APPROVED	DRAWING NO.
SCALE N.T.S.	DATE 2-2-06	NO.	DATE	REVISION	
COMPUTER FILE					
1566653.dwg					
PRECAST DROP MANHOLE.DWG					

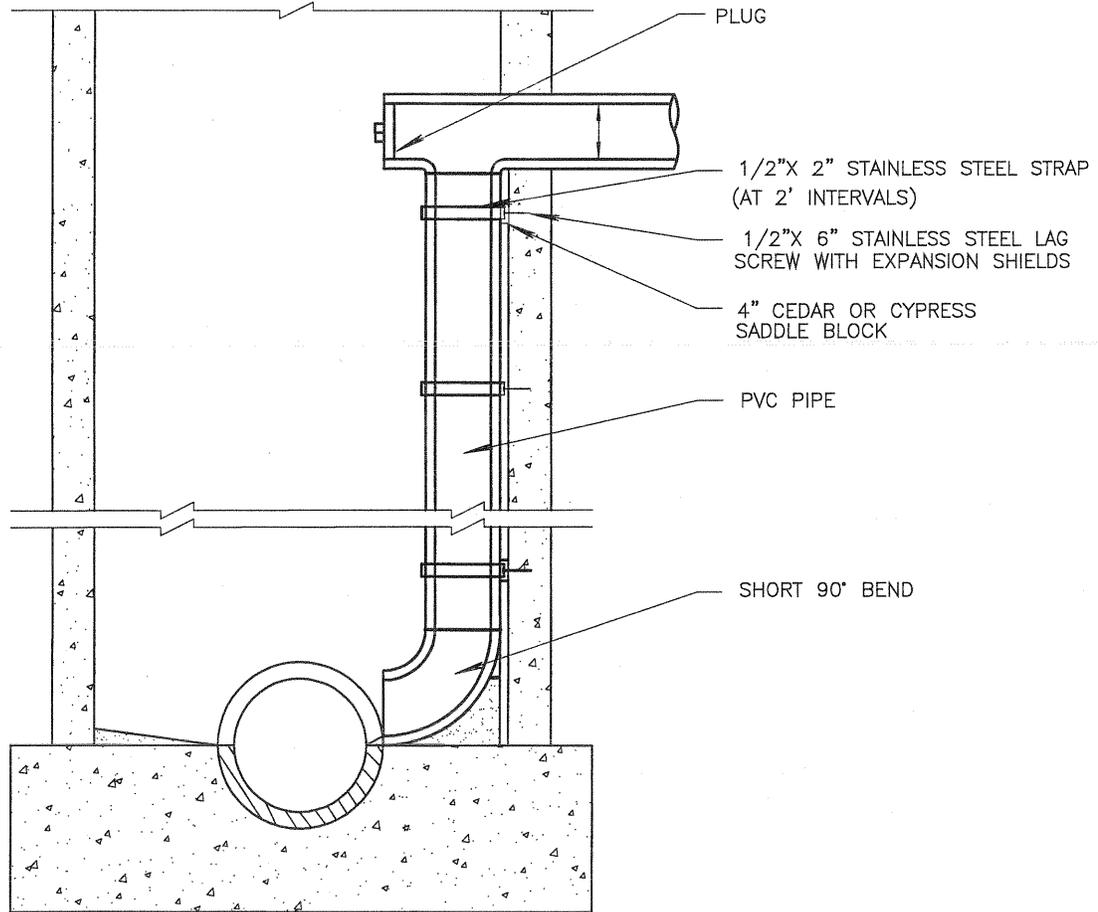

(USED ONLY WITH EXPRESS APPROVAL OF SANITARY DISTRICT)

S.5

Martenson & Eisele, Inc.




1377 Midway Road
Menasha, WI 54952
www.martenson-eisele.com
info@martenson-eisele.com
920.731.0381 1.800.236.0381

Planning
Environmental
Surveying
Engineering
Architecture

INSIDE DROP MANHOLE

FIELD BK	PAGE		DRAWN BY EAE	CHECKED	APPROVED	DRAWING NO.
SCALE N.T.S.	DATE 2-2-06	NO.	DATE	REVISION		
COMPUTER FILE						
1156905drcwrtngs						
INSIDE DROP MANHOLE.DWG						

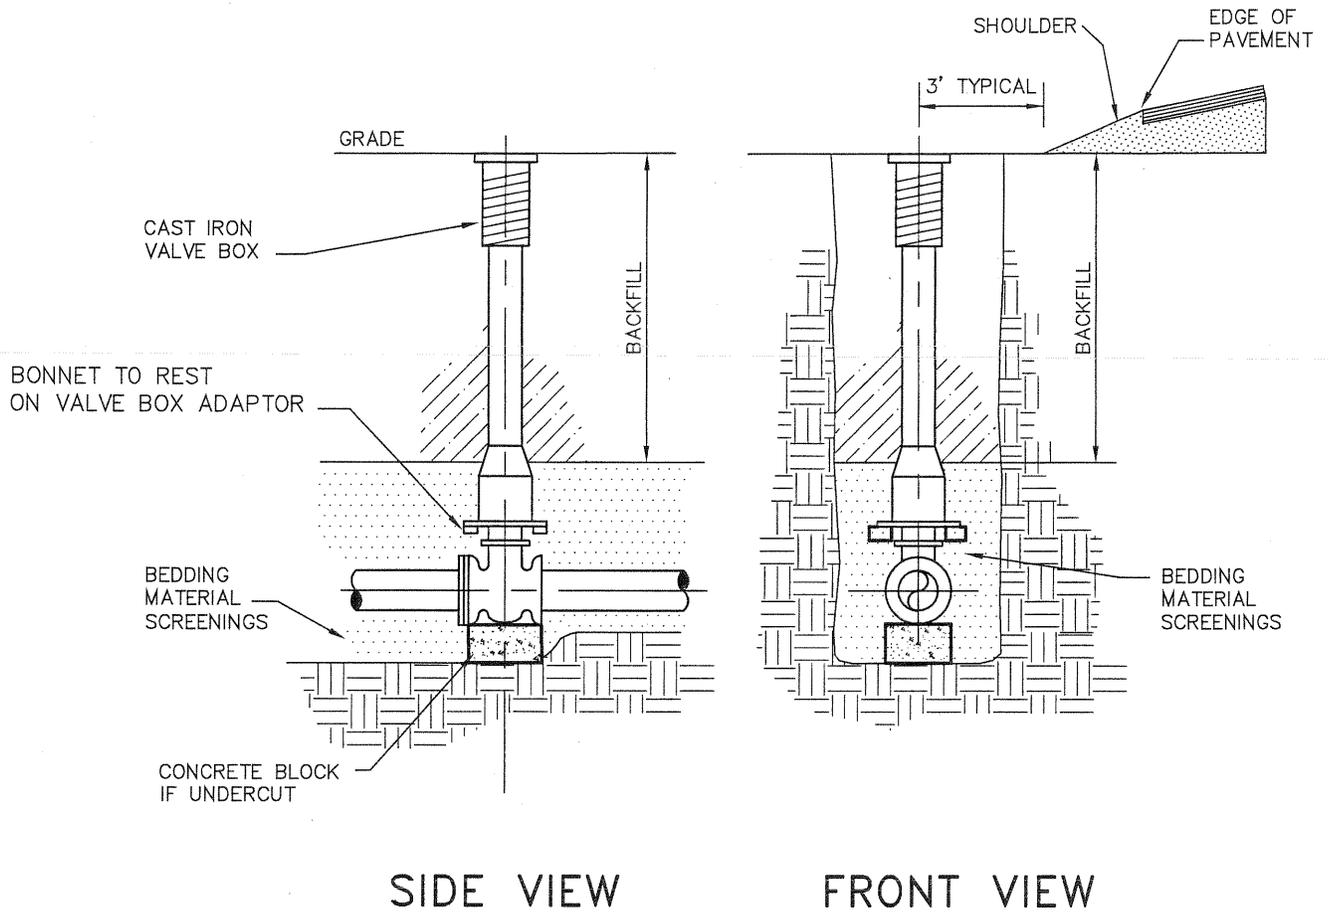

ALL VALVES SHALL BE PLACED
OUTSIDE OF PAVEMENT.

S.6

Martenson & Eisele, Inc.



1377 Midway Road
Menasha, WI 54952
www.martenson-eisele.com
info@martenson-eisele.com
920.731.0381 1.800.236.0381

Planning
Environmental
Surveying
Engineering
Architecture

STANDARD VALVE & VALVE BOX SETTING

FIELD BK	PAGE		DRAWN BY EAE	CHECKED	APPROVED	DRAWING NO.
SCALE N.T.S.	DATE 2-2-06	NO.	DATE	REVISION		
COMPUTER FILE						
166605.dwg						
VALVE & VALVE BOX.DWG						

NOTES:

1. DIMENSIONS IN TABLE ARE BASED ON A WATER PRESSURE OF 150 P.S.I. AND ON EARTH RESISTANCE OF 2 TONS PER SQ. FT.


2. DIMENSION C1-3 SHOULD BE LARGE ENOUGH TO MAKE ANGLE EQUAL TO OR LARGER THAN 45°.

3. DIMENSION A1-3 SHOULD BE AS LARGE AS POSSIBLE WITHOUT INTERFERING WITH M.J. BOLTS.


4. SHAPE OF BACK OF BUTTRESS MAY VARY AS LONG AS POUR IS AGAINST FIRM UNDISTURBED EARTH.

5. ALL IRON PIPE AND FITTINGS SHALL BE WRAPPED IN POLYETHYLENE.

6. ALL UNDERGROUND BOLTS TO BE CORE BLUE.

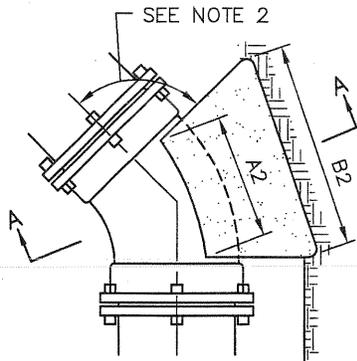


PLAN - 45° BEND

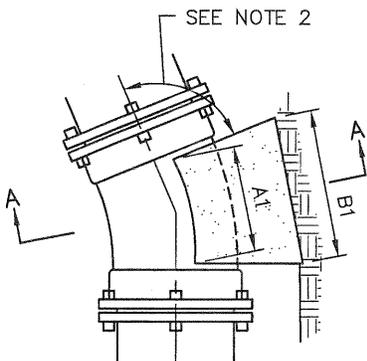

PLAN - 22-1/2° BEND

BUTTRESS DIMENSIONS				
PIPE SIZE	22-1/2° BENDS		45° BENDS	
	B1	D1	B2	D2
6"	1'-0"	1'-0"	1'-0"	1'-0"
8"	1'-0"	1'-0"	1'-4"	1'-2"
12"	1'-4"	1'-4"	1'-10"	1'-10"
16"	1'-10"	1'-8"	2'-6"	2'-4"
20"	2'-4"	2'-0"	3'-3"	2'-10"
24"	2'-10"	2'-4"	4'-0"	3'-3"
30"	3'-6"	3'-0"	5'-4"	3'-10"

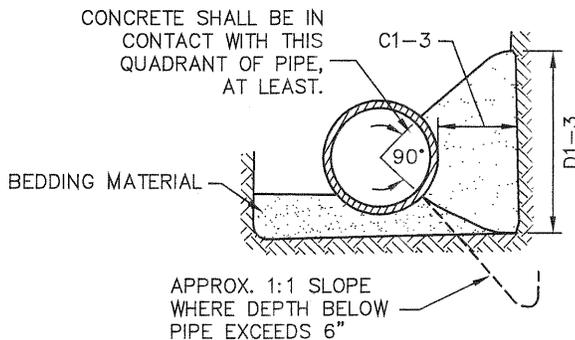

SECTION A-A

S.7

Martenson & Eisele, Inc.


1377 Midway Road
Menasha, WI 54952
www.martenson-eisele.com
info@martenson-eisele.com
920.731.0381 1.800.236.0381

Planning
Environmental
Surveying
Engineering
Architecture



MEGALUG & BLOCKING FOR BENDS

FIELD BK	PAGE	NO.	DATE	REVISION	DRAWING NO.
SCALE N.T.S.	DATE 2-2-06				
COMPUTER FILE					
1156905d\drawings					
BLOCKING FOR BENDS.DWG					

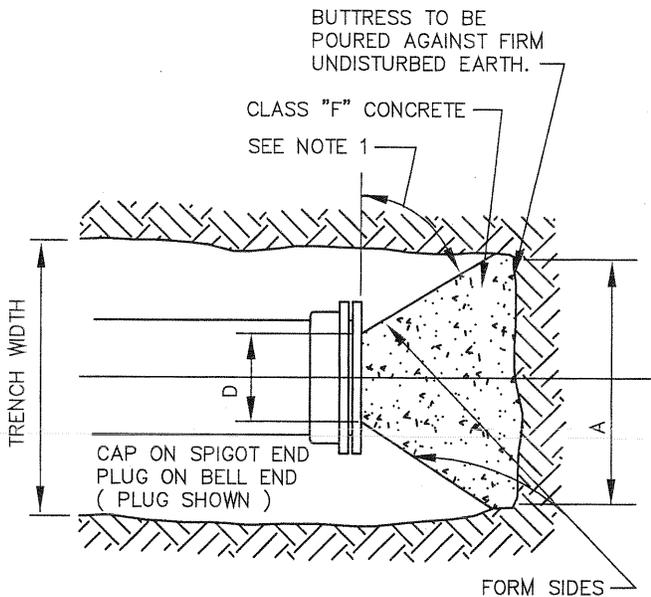


BUTTRESS DIMENSIONS				
DIA.	A	B	C	D
6"	1'-6"	1'-2"	SEE NOTE 2	SEE NOTE 3
8"	2'-0"	1'-4"		
12"	2'-5"	1'-10"		
16"	3'-4"	2'-4"		
20"	4'-3"	2'-10"		
24"	5'-2"	3'-4"		
30"	6'-9"	4'-0"		

NOTES:

1. DIMENSIONS IN TABLE ARE BASED ON A WATER PRESSURE OF 150 P.S.I. AND ON EARTH RESISTANCE OF 2 TONS PER SQ. FT.
2. DIMENSION C SHOULD BE LARGE ENOUGH TO MAKE ANGLE EQUAL TO OR LARGER THAN 45°.
3. DIMENSION D SHOULD BE AS LARGE AS POSSIBLE WITHOUT INTERFERING WITH M.J. BOLTS.
4. SHAPE OF BACK OF BUTTRESS MAY VARY AS LONG AS POUR IS AGAINST FIRM UNDISTURBED EARTH.
5. ALL IRON PIPE AND FITTINGS SHALL BE WRAPPED IN POLYETHYLENE.
6. ALL UNDERGROUND BOLTS TO BE CORE BLUE.

PLAN

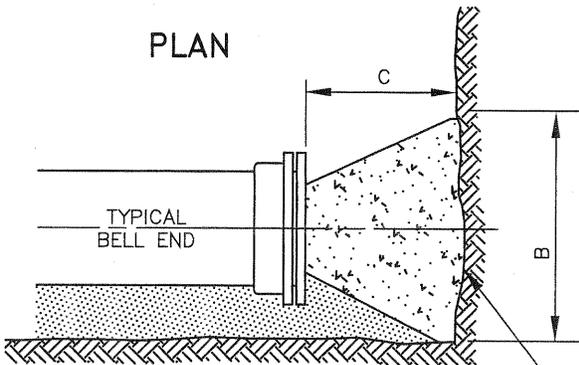

ELEVATION

BUTTRESS TO BE POURED AGAINST FIRM UNDISTURBED EARTH.

S.8

Martenson & Eisele, Inc.




1377 Midway Road
Menasha, WI 54952
www.martenson-eisele.com
info@martenson-eisele.com
920.731.0381 1.800.236.0381

Planning
Environmental
Surveying
Engineering
Architecture


BLOCKING FOR PLUGS

FIELD BK	PAGE	NO.	DATE	REVISION	DRAWING NO.
SCALE N.T.S.	DATE 2-2-96				
COMPUTER FILE					
1156805.drw					
BLOCKING FOR PLUGS.DWG					

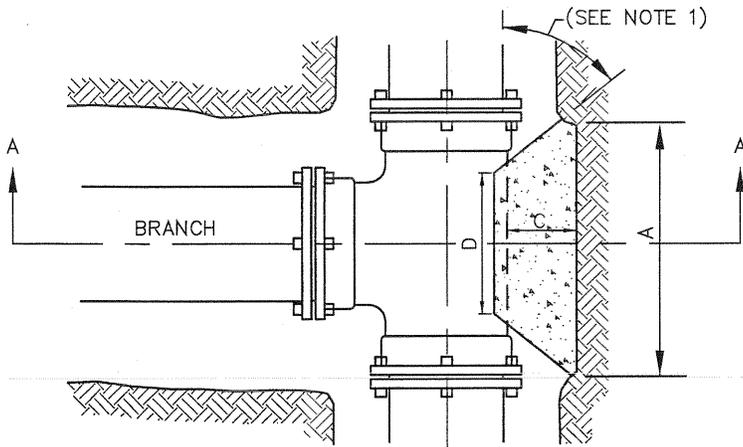

BUTTRESS DIMENSIONS				
B.D.	A	B	C	D
6"	1'-3"	1'-0"	SEE NOTE 1	SEE NOTE 2
8"	1'-6"	1'-4"		
12"	2'-3"	2'-0"		
16"	3'-2"	2'-6"		
20"	4'-0"	3'-0"		
24"	5'-3"	3'-4"		
30"	6'-6"	4'-3"		

B.D. = BRANCH DIAMETER

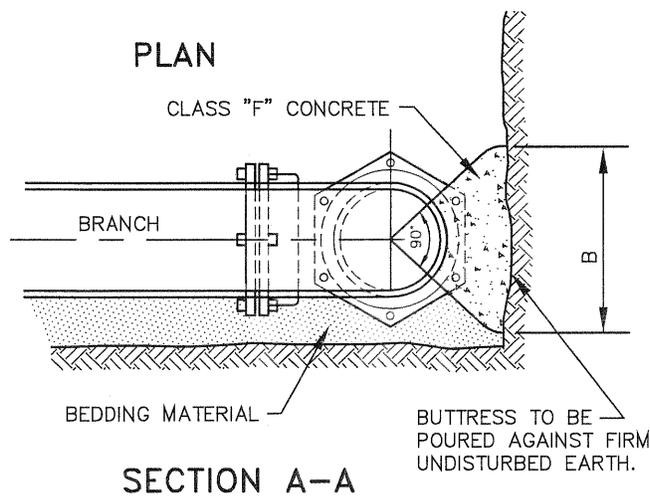

NOTES:

1. DIMENSION "C" SHOULD BE LARGE ENOUGH TO MAKE ANGLE EQUAL TO OR LARGER THAN 45°.
2. DIMENSION "D" EQUALS APPROX. I.D. OF PIPE LESS 2". AN EFFORT SHOULD BE MADE TO PREVENT THE CONCRETE FROM COVERING THE M.J. BOLTS.
3. WHERE BUTTRESSES ARE NOT POSSIBLE BECAUSE OF POOR SOIL CONDITIONS OR LACK OF ROOM, STRAPPING SHALL BE PERMITTED.
4. DIMENSIONS IN TABLE ARE BASED ON A WATER PRESSURE OF 150 P.S.I. AND ON EARTH RESISTANCE OF 2 TONS PER SQ. FT.
5. ALL UNDERGROUND BOLTS TO BE CORE BLUE.

S.9

Martenson & Eisele, Inc.




1377 Midway Road
 Menasha, WI 54952
 www.martenson-eisele.com
 info@martenson-eisele.com
 920.731.0381 1.800.236.0381

Planning
 Environmental
 Surveying
 Engineering
 Architecture

MEGALUG & BLOCKING FOR TEES

FIELD BK	PAGE	DRAWN BY	CHECKED	APPROVED	DRAWING NO.
SCALE	DATE	NO.	DATE	REVISION	
N.T.S.	2-2-06				
COMPUTER FILE					
\\156956\drawings\BLOCKING FOR TEES.DWG					

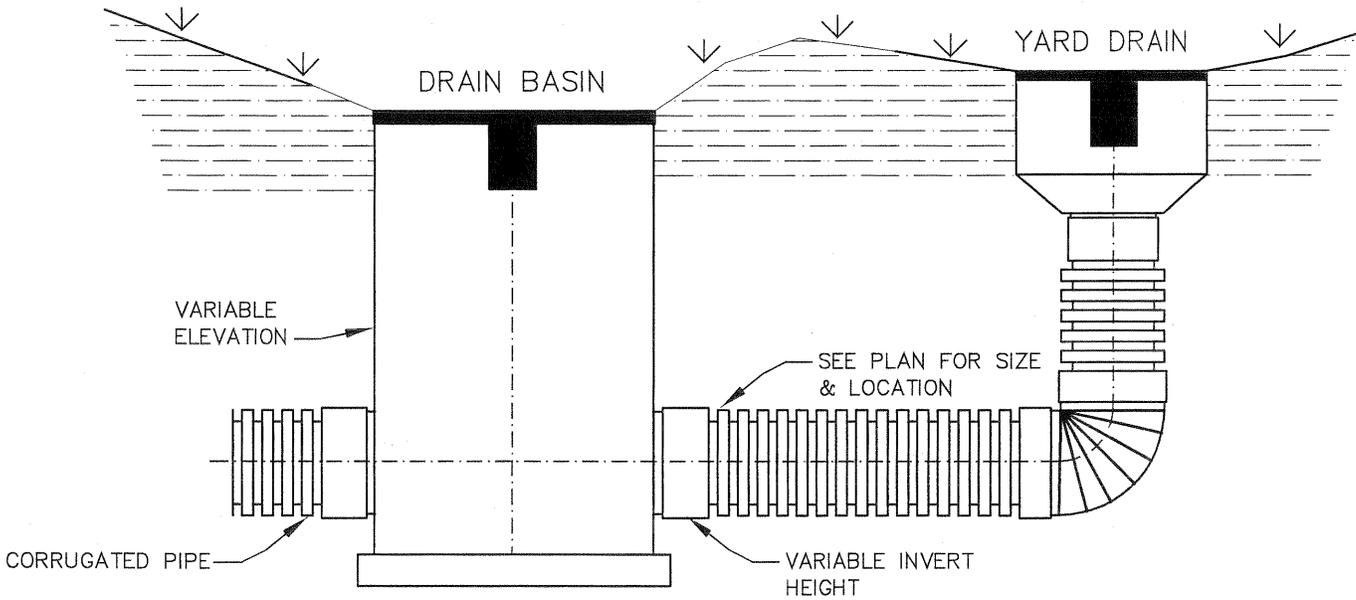

S.13

Martenson & Eisele, Inc.


1377 Midway Road
 Menasha, WI 54952
 www.martenson-eisele.com
 info@martenson-eisele.com
 920.731.0381 1.800.236.0381




Planning
 Environmental
 Surveying
 Engineering
 Architecture

HDPE YARD DRAIN

FIELD BK	PAGE		DRAWN BY EAE	CHECKED	APPROVED	DRAWING NO.
SCALE N.T.S.	DATE 2-2-06	NO.	DATE	REVISION		
COMPUTER FILE						
\\156905ndrawings\						
YARD DRAIN.DWG						

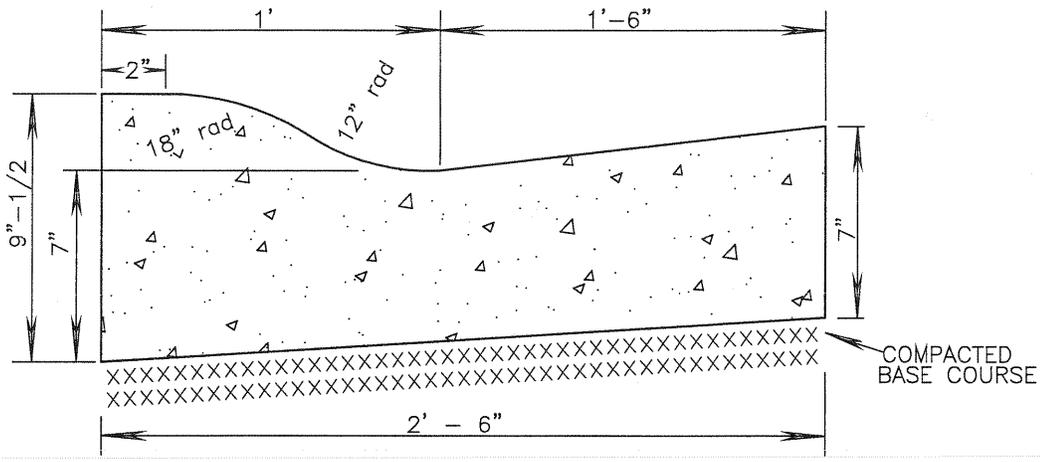

30" MOUNTABLE CURB & GUTTER

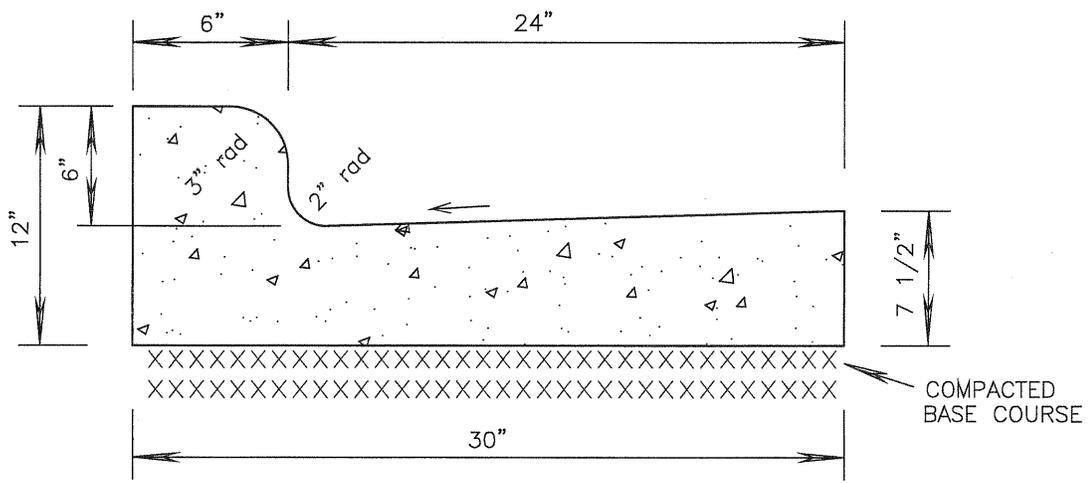

30" CURB & GUTTER

S.14

Martenson & Eisele, Inc.




1377 Midway Road
 Menasha, WI 54952
 www.martenson-eisele.com
 info@martenson-eisele.com
 920.731.0381 1.800.236.0381


Planning
 Environmental
 Surveying
 Engineering
 Architecture

CURB & GUTTER DETAILS

FIELD BK	PAGE	DRAWN BY	CHECKED	APPROVED	DRAWING NO.
SCALE	DATE	NO.	DATE	REVISION	
N.T.S.	2-2-06				
COMPUTER FILE					
1156905.drdrawings					
30 CURB & GUTTER.DWG					

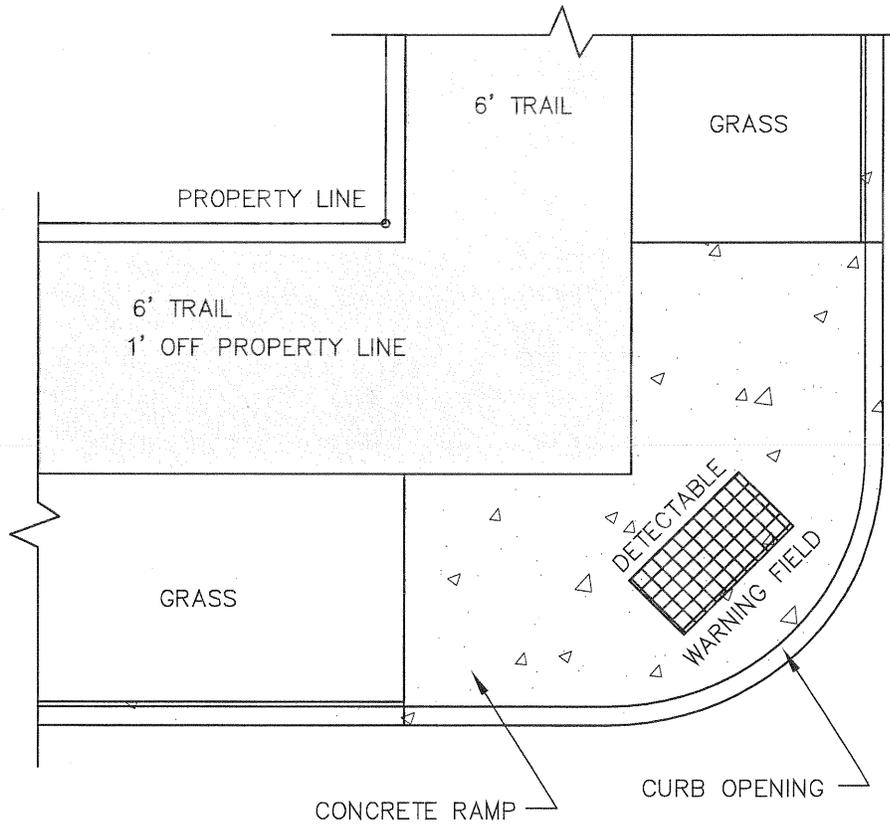

DETECTABLE WARNING FIELD



DETAIL

S.15

Martenson & Eisele, Inc.




1377 Midway Road
Menasha, WI 54952
www.martenson-eisele.com
info@martenson-eisele.com
920.731.0381 1.800.236.0381

Planning
Environmental
Surveying
Engineering
Architecture

TYPICAL TRAIL RAMP

FIELD BK	PAGE	DRAWN BY	CHECKED	APPROVED	DRAWING NO.
SCALE	DATE	NO.	DATE	REVISION	
N.T.S.	2-2-06				
COMPUTER FILE					
\\156905\drawings					
TRAIL_RAMP.DWG					

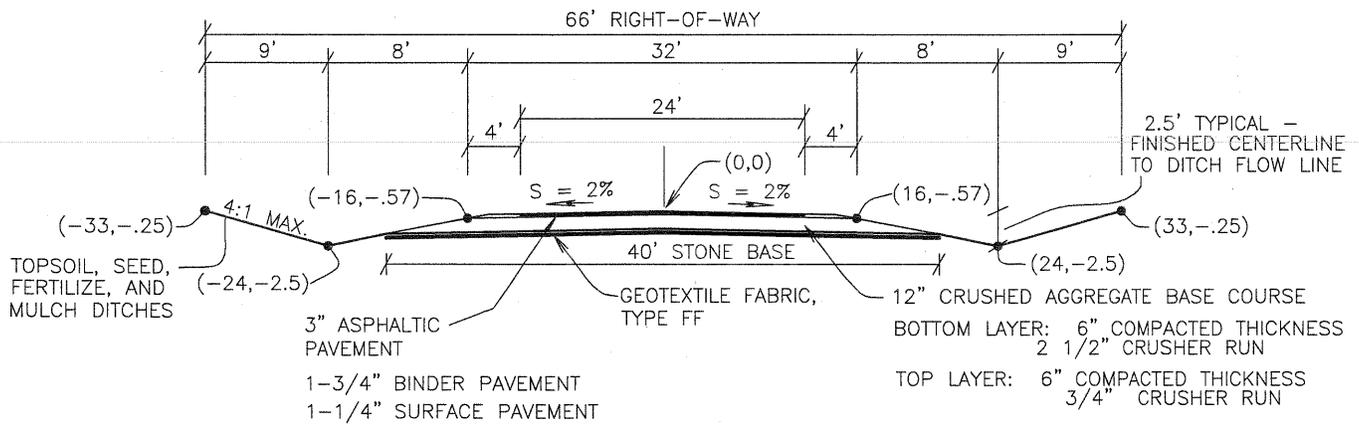

S.16

Martenson & Eisele, Inc.




1377 Midway Road
Menasha, WI 54952
www.martenson-eisele.com
info@martenson-eisele.com
920.731.0381 1.800.236.0381

Planning
Environmental
Surveying
Engineering
Architecture

TYPICAL STREET SECTION (66' R.O.W.) RURAL - LOCAL

FIELD BK	PAGE	DRAWN BY EAE	CHECKED	APPROVED	DRAWING NO.
SCALE N.T.S.	DATE 2-2-06	NO.	DATE	REVISION	
COMPUTER FILE					
Y156905drawings					
TYPICAL RURAL SECTION - LOCAL					

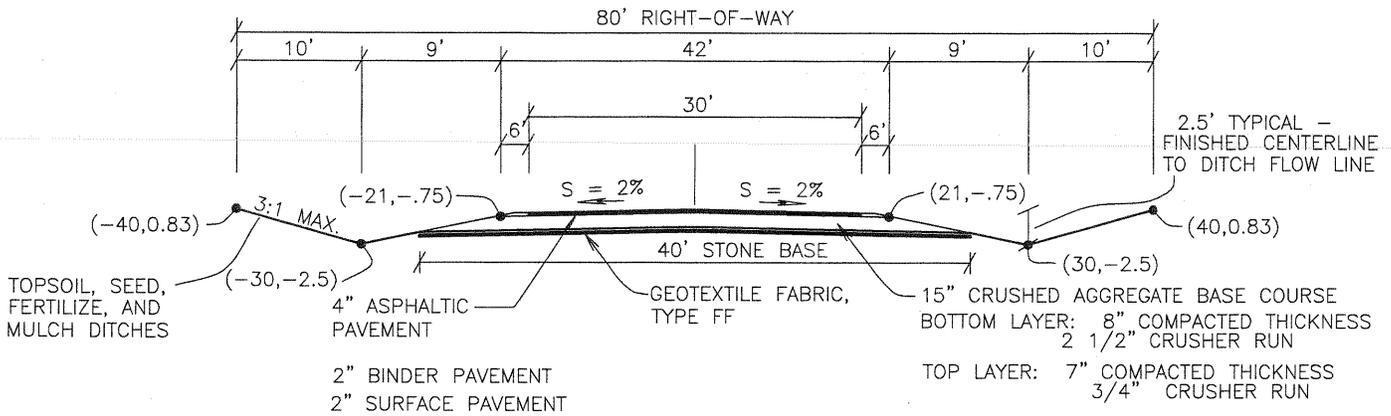

S.17

Martenson & Eisele, Inc.




1377 Midway Road
Menasha, WI 54952
www.martenson-eisele.com
info@martenson-eisele.com
920.731.0381 1.800.236.0381

Planning
Environmental
Surveying
Engineering
Architecture

TYPICAL STREET SECTION (80' R.O.W.) RURAL - COLLECTOR

FIELD BK	PAGE		DRAWN BY EAE	CHECKED	APPROVED	DRAWING NO.
SCALE N.T.S.	DATE 2-2-06	NO	DATE	REVISION		
COMPUTER FILE						
(156905drawings)						
TYPICAL RURAL SECTION - COLLECTOR						

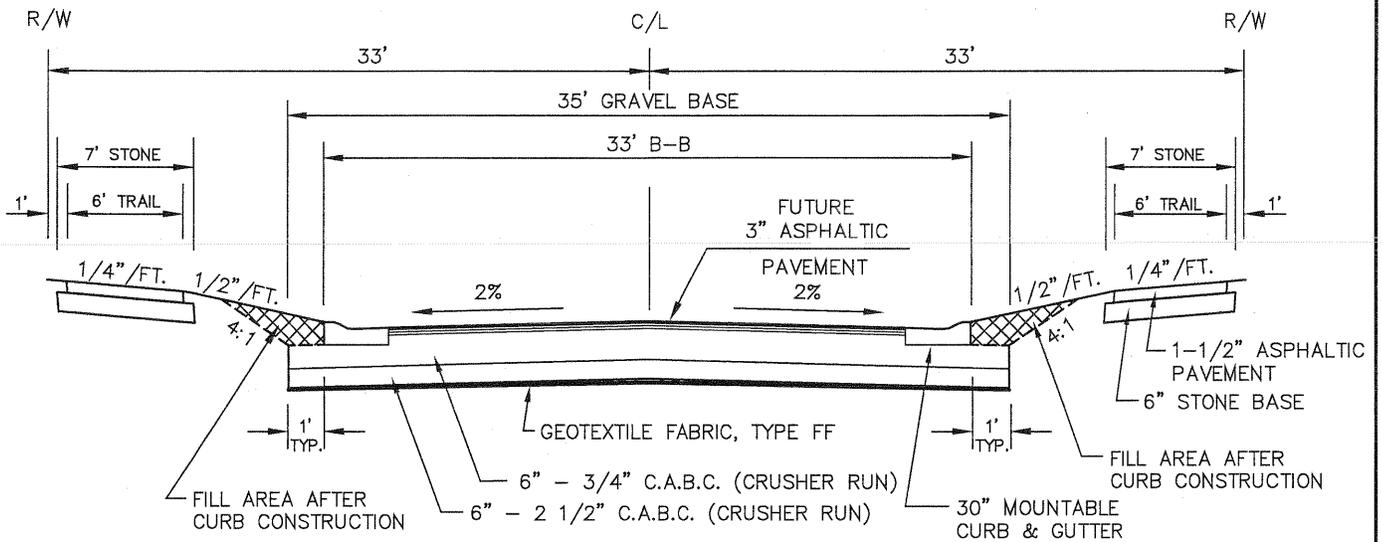

C/L -0.36 = F/L
 C/L -0.11 = T/C
 C/L +0.43 = R/W

NOTE: 6' WIDE BITUMINOUS REC. TRAIL TO BE PAVED WHEN FINAL SURFACE COAT IS PLACED.

S.18

Martenson & Eisele, Inc.




1377 Midway Road
 Menasha, WI 54952
 www.martenson-eisele.com
 info@martenson-eisele.com
 920.731.0381 1.800.236.0381

Planning
 Environmental
 Surveying
 Engineering
 Architecture

TYPICAL STREET SECTION (66' R.O.W.) URBAN - LOCAL

FIELD BK	PAGE	DRAWN BY		CHECKED	APPROVED	DRAWING NO.
		EAE				
SCALE	DATE	NO.	DATE	REVISION		
N.T.S.	2-2-06					
COMPUTER FILE						
11569053rdwrtngs						
TYPICAL URBAN SECTION (66' R.O.W.)						

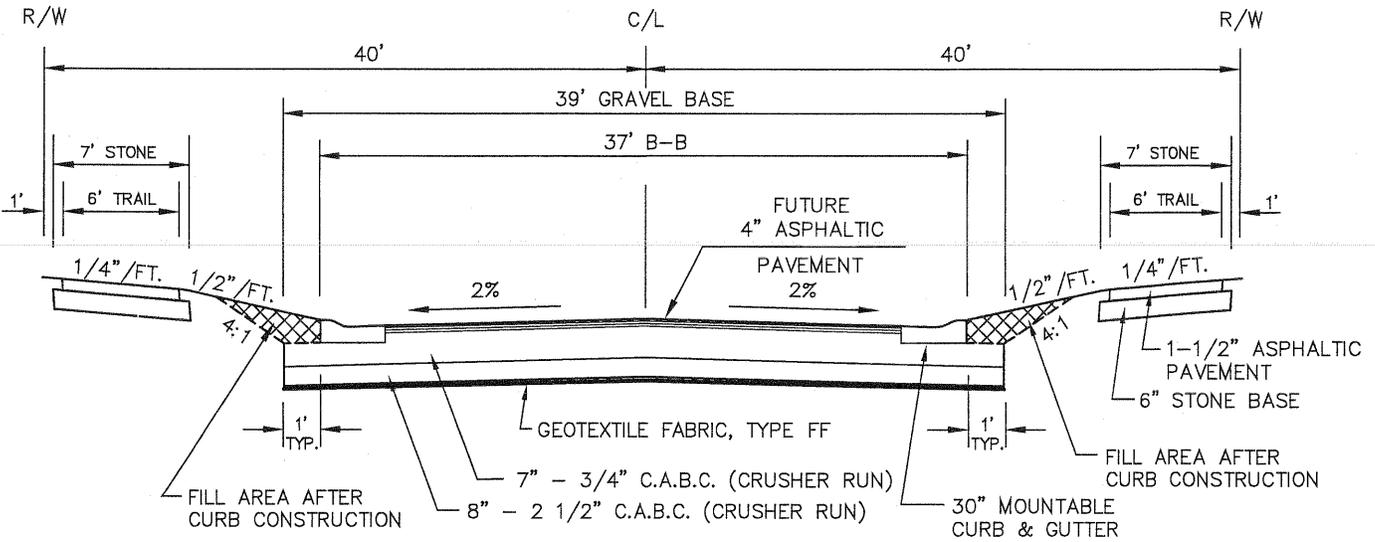

C/L -0.40 = F/L
 C/L -0.15 = T/C
 C/L +0.60 = R/W

NOTE: 6' WIDE BITUMINOUS REC. TRAIL TO BE PAVED WHEN FINAL SURFACE COAT IS PLACED.

S.19

Martenson & Eisele, Inc.




1377 Midway Road
 Menasha, WI 54952
 www.martenson-eisele.com
 info@martenson-eisele.com
 920.731.0381 1.800.236.0381

Planning
 Environmental
 Surveying
 Engineering
 Architecture

**TYPICAL STREET SECTION (80' R.O.W.)
 URBAN - COLLECTOR**

FIELD BK	PAGE	DRAWN BY	CHECKED	APPROVED	DRAWING NO.
SCALE	DATE	NO.	DATE	REVISION	
N.T.S.	2-2-06				
COMPUTER FILE					
116605d\drawings					
TYPICAL URBAN SECTION (80' R.O.W.)					

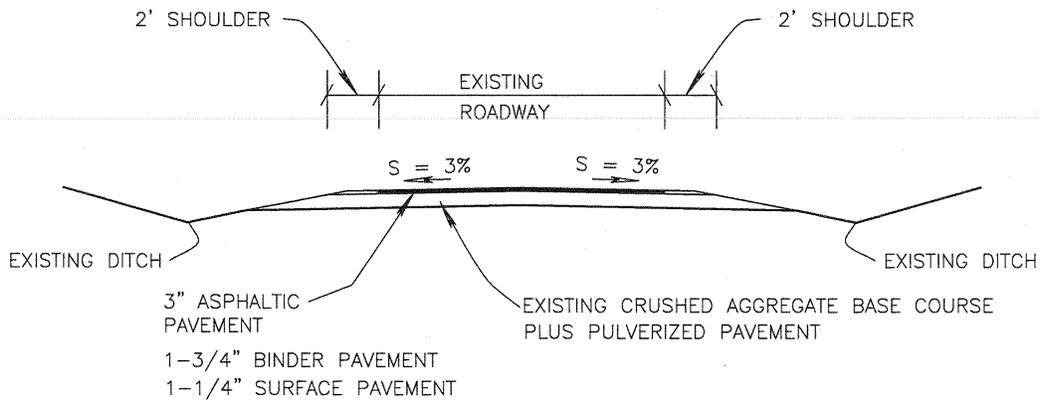

S.20

Martenson & Eisele, Inc.





1377 Midway Road
 Menasha, WI 54952
 www.martenson-eisele.com
 info@martenson-eisele.com
 920.731.0381 1.800.236.0381

Planning
 Environmental
 Surveying
 Engineering
 Architecture

PULVERIZED ROAD DETAIL

FIELD BK	PAGE	DRAWN BY EAE	CHECKED	APPROVED	DRAWING NO.
SCALE N.T.S.	DATE 10-10-06	NO.	DATE	REVISION	
COMPUTER FILE					
1156905.dwg					
PULVERIZED ROAD DETAIL					

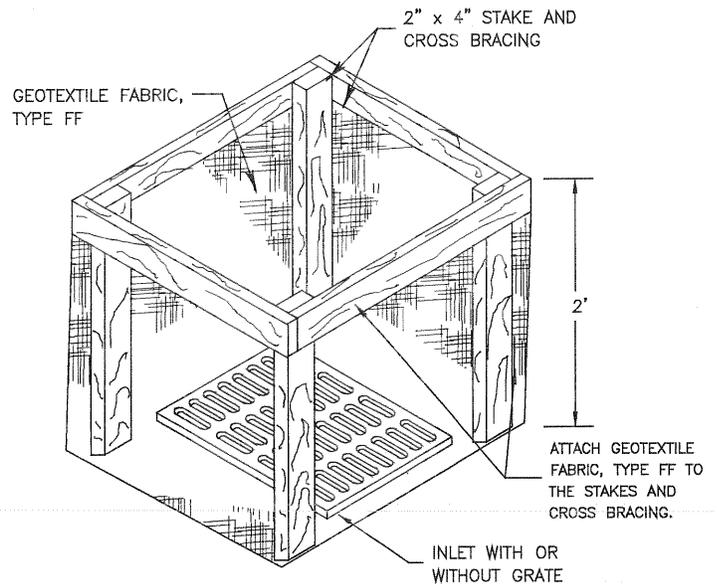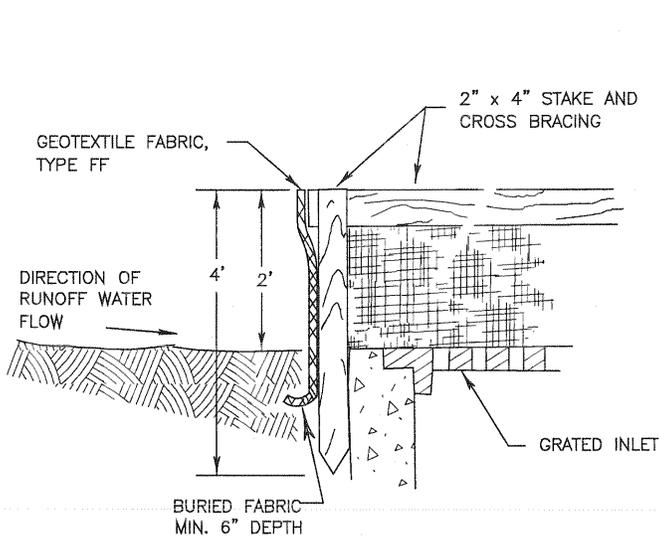

INLET PROTECTION, TYPE A

GENERAL NOTES

MANUFACTURED ALTERNATIVES APPROVED AND LISTED ON THE DEPARTMENT'S EROSION CONTROL PRODUCT ACCEPTABILITY LIST MAY BE SUBSTITUTED.

WHEN REMOVING OR MAINTAINING INLET PROTECTION, CARE SHALL BE TAKEN SO THAT THE SEDIMENT TRAPPED ON THE GEOTEXTILE FABRIC DOES NOT FALL INTO THE INLET. ANY MATERIAL FALLING INTO THE INLET SHALL BE REMOVED IMMEDIATELY.

- ① FINISHED SIZE, INCLUDING FLAP POCKETS WHERE REQUIRED, SHALL EXTEND A MINIMUM OF 10" AROUND THE PERIMETER TO FACILITATE MAINTENANCE OR REMOVAL.
- ② FOR INLET PROTECTION, TYPE C (WITH CURB BOX), AN ADDITIONAL 18" OF FABRIC IS WRAPPED AROUND THE WOOD AND SECURED WITH STAPLES. THE WOOD SHALL NOT BLOCK THE ENTIRE HEIGHT OF THE CURB BOX OPENING.
- ③ FLAP POCKETS SHALL BE LARGE ENOUGH TO ACCEPT WOOD 2X4.

S.21

Martenson & Eisele, Inc.




1377 Midway Road
Menasha, WI 54952
www.martenson-eisele.com
info@martenson-eisele.com
920.731.0381 1.800.236.0381


Planning
Environmental
Surveying
Engineering
Architecture

INLET PROTECTION, TYPE A

FIELD BK	PAGE	DRAWN BY EAE	CHECKED	APPROVED	DRAWING NO.
SCALE N.T.S.	DATE 10-10-08	NO.	DATE	REVISION	
COMPUTER FILE					
\\56956ofrdawings					
INLET PROTECTION TYPE A.DWG					

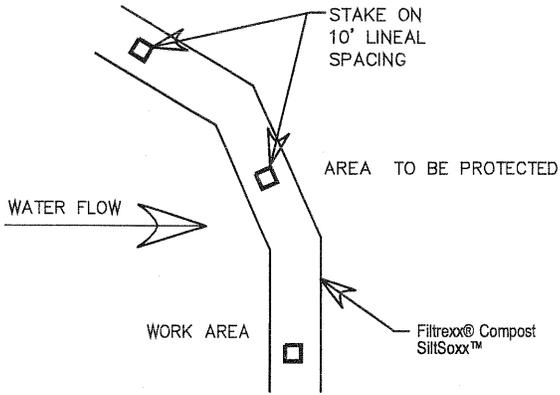

**Filtrex@SiltSoxx™
Plan View**

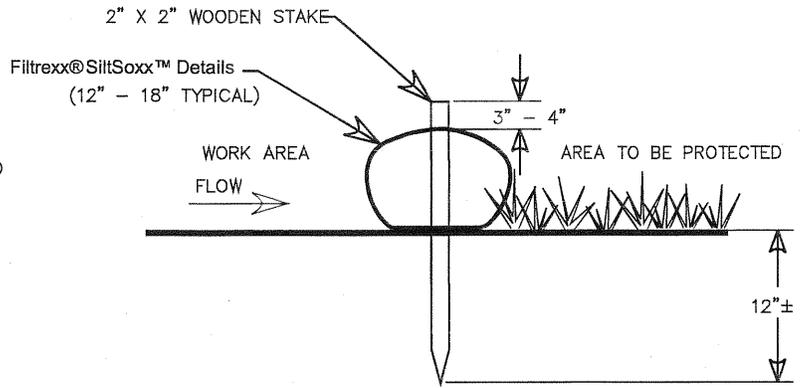


Filtrex@SiltSoxx™ Section

Filtrex@SiltSoxx™ Details

NOTES:

1. ALL MATERIAL TO MEET FILTREXX® SPECIFICATIONS
2. SILTSOXX™ COMPOST/JSOIL/ROCK/SEED FILL TO MEET APPLICATION REQUIREMENTS.
3. SILTSOXX™ DEPICTED IS FOR MINIMUM SLOPES. GREATER SLOPES MAY REQUIRE LARGER SOCKS PER THE ENGINEER.
4. COMPOST MATERIAL TO BE DISPERSED ON SITE, AS DETERMINED BY ENGINEER.

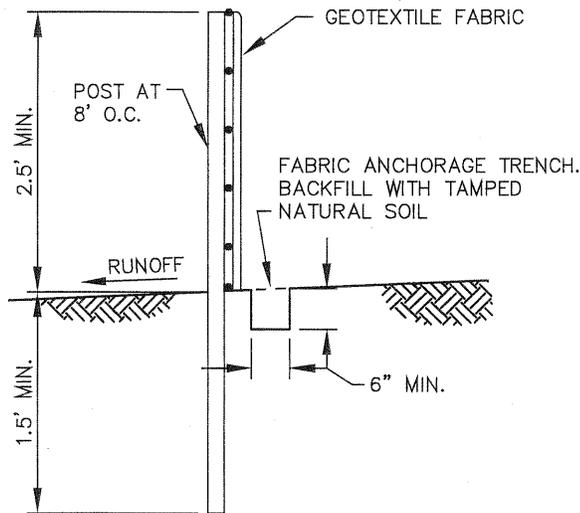

S.22

Martenson & Eisele, Inc.




1377 Midway Road
Menasha, WI 54952
www.martenson-eisele.com
info@martenson-eisele.com
920.731.0381 1.800.236.0381

Planning
Environmental
Surveying
Engineering
Architecture

**SOCK & SILT FENCE -
INSTALLATION DETAIL**

FIELD BK	PAGE	DRAWN BY EAE	CHECKED	APPROVED	DRAWING NO.
SCALE N.T.S.	DATE 2-2-06	NO.	DATE	REVISION	
COMPUTER FILE					
\\156905\drawings\					
SILT FENCE.DWG					

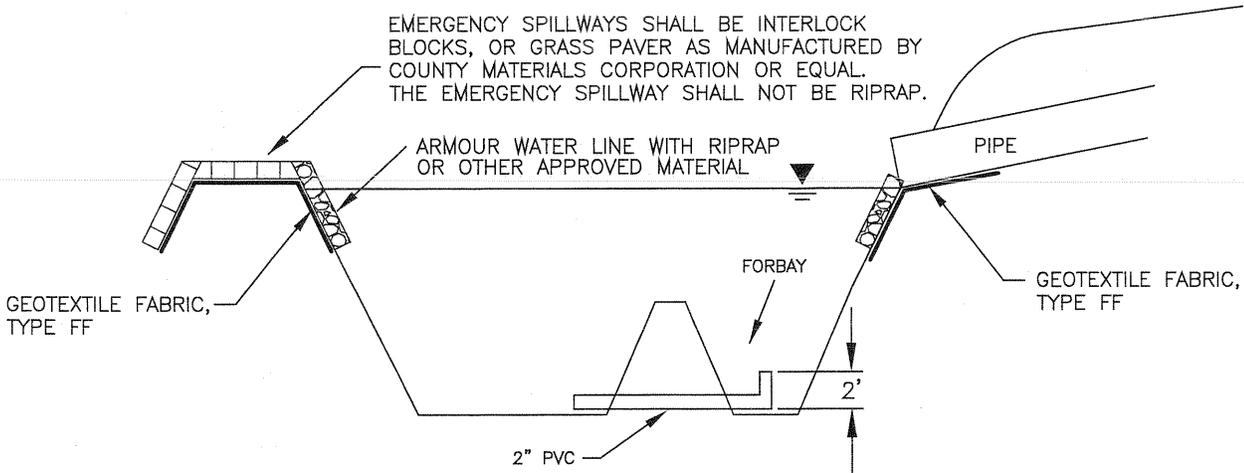

ALL CLAY LINERS SHALL BE TESTED AND CONFORM TO THE WDNR STORM WATER MANAGEMENT TECHNICAL STANDARDS.

S.23

Martenson & Eisele, Inc.




1377 Midway Road
 Menasha, WI 54952
 www.martenson-eisele.com
 info@martenson-eisele.com
 920.731.0381 1.800.236.0381

Planning
 Environmental
 Surveying
 Engineering
 Architecture

POND DETAIL

FIELD BK	PAGE		DRAWN BY EAE	CHECKED	APPROVED	DRAWING NO.
SCALE N.T.S.	DATE 2-2-06	NO.	DATE	REVISION		
COMPUTER FILE						
1156905\drawings\						
POND.DWG						

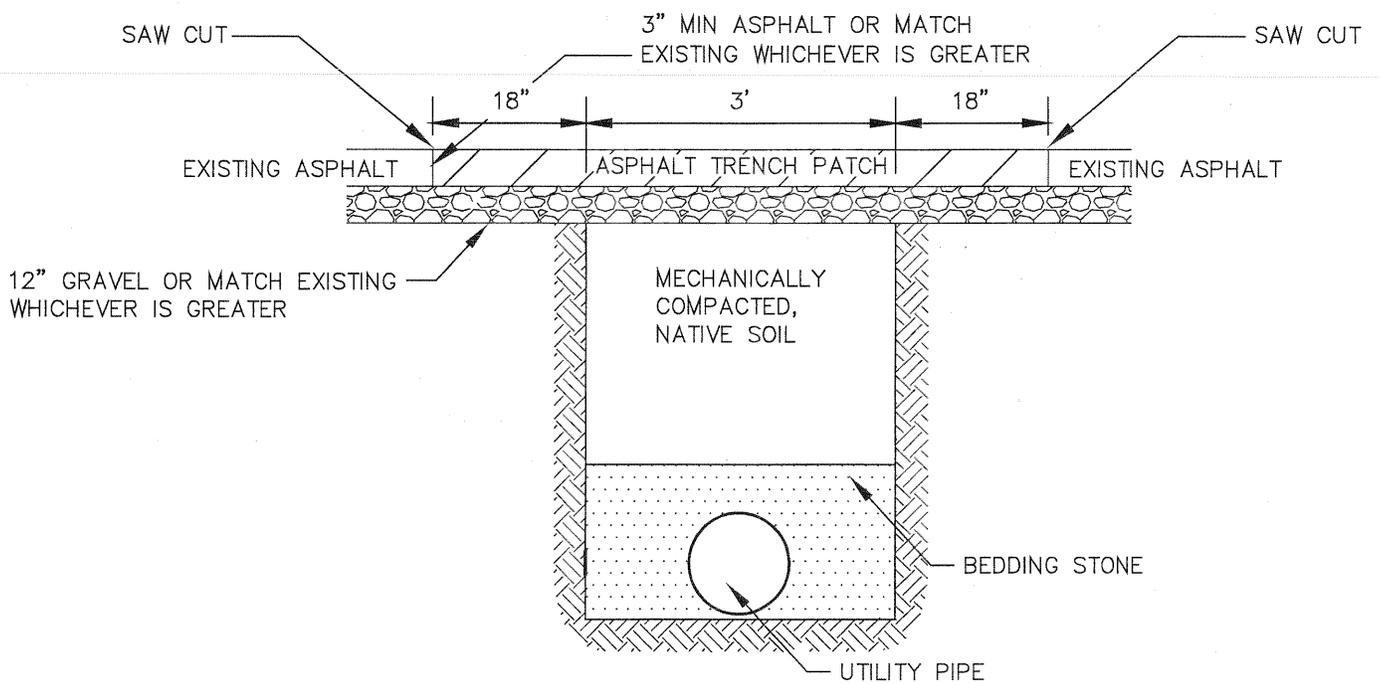

S.24

Martenson & Eisele, Inc.




1377 Midway Road
 Menasha, WI 54952
 www.martenson-eisele.com
 info@martenson-eisele.com
 920.731.0381 1.800.236.0381


Planning
 Environmental
 Surveying
 Engineering
 Architecture

UTILITY TRENCH REPAIR DETAIL



FIELD BK	PAGE		DRAWN BY EAE	CHECKED	APPROVED	DRAWING NO.
SCALE N.T.S.	DATE 2-2-06	NO.	DATE	REVISION		
COMPUTER FILE						
1166605d\drawings\						
UTILITY TRENCH.DWG						

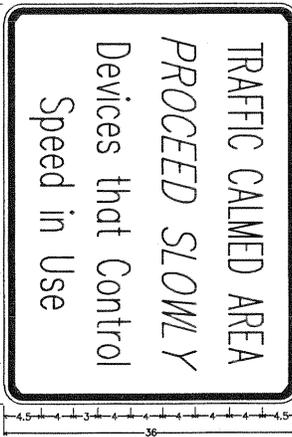

2.37" Radius, 0.6" Border, 0.5" Inset, Block on Yellow, Traffic Calmed Area] B 60" spacing, [Proceed Slowly] B 200" spacing, [Devices that Control] B 30" spacing, [Speed in Use] B 30" spacing, REFLECTIVE SHEETING SIGN

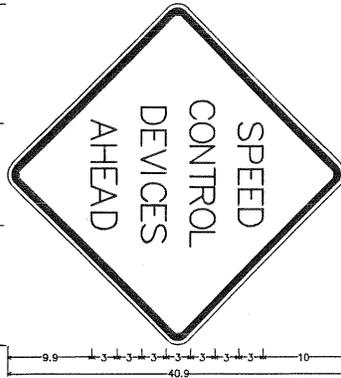

SPEED CONTROL DEVICES AHEAD, 30.0" across apex 1.9" Radius, 0.6" Border, 0.5" Inset, Block on Yellow, [SPEED] D Georgia, [CONTROL] D Georgia, [DEVICES] D Georgia, [AHEAD] D Georgia, REFLECTIVE SHEETING SIGN

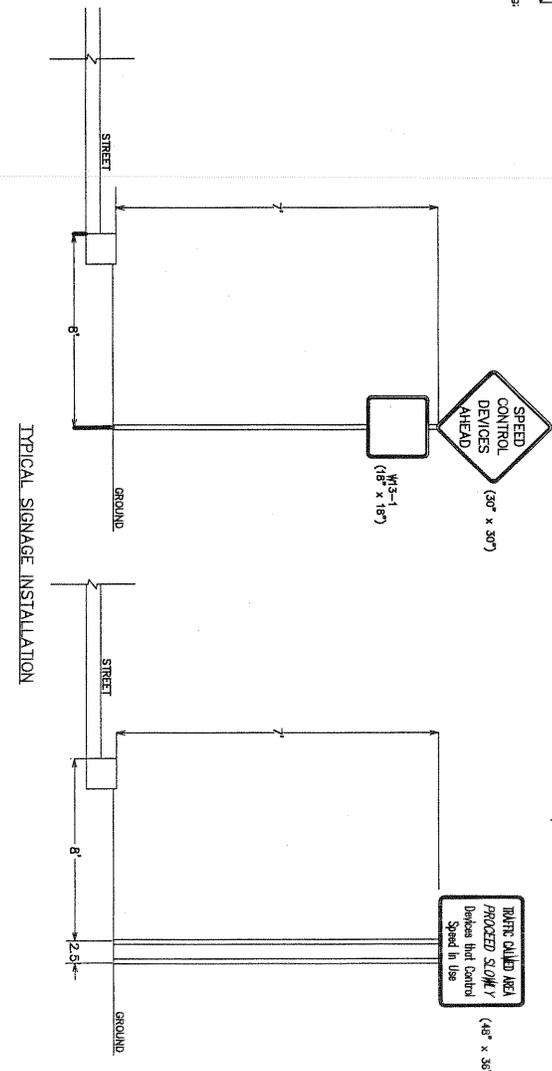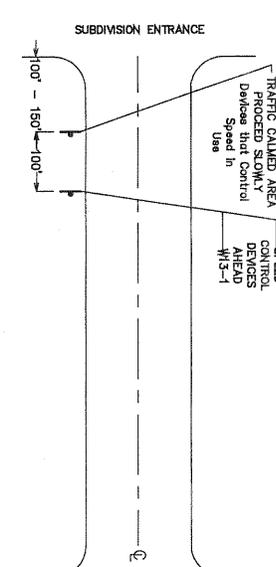

S.25

MINNETT COUNTY TRAFFIC CALMING DESIGN GUIDE
NONSTANDARD SIGNS AND INSTALLATION DETAILS
DRAWING NO. TC-01


Martenson & Eisele, Inc.
1377 Midway Road
Menasha, WI 54952
www.martenson-eisele.com
info@martenson-eisele.com
920.731.0381 1.800.236.0381

Planning
Environmental
Surveying
Engineering
Architecture

NONSTANDARD SIGNS AND INSTALLATION DETAILS

FIELD BK	PAGE	DRAWN BY	CHECKED	APPROVED	DRAWING NO.
SCALE	DATE	NO.	DATE	REVISION	
COMPUTER FILE					
TrafficCalming06CAD.dwg					

S.26

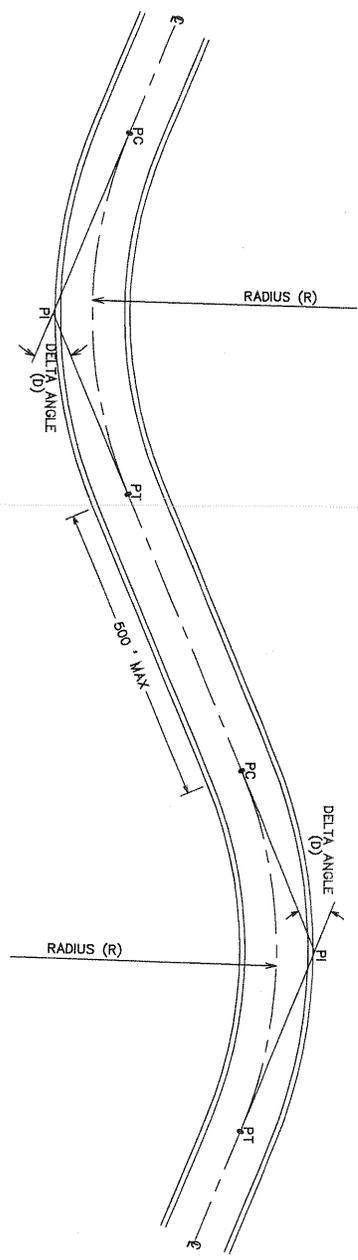

LOW SPEED CURVE VALUES

DELTA ANGLE (D)	RADIUS (R)
30° - 40° (30° MIN)	100'
41° - 50°	120' (MIN) - 130' (MAX)
>=51°	120' (MIN) - 150' (MAX)

NOTE: 1. WHEN COMPOUND CURVES ARE USED, THE MAXIMUM RATIO OF THE FLATTER RADIUS TO THE SHARPER RADIUS SHOULD BE 1.75:1.
 2. ENSURE INTERSECTION SIGHT DISTANCE IS MAINTAINED AT ALL ROADS & DRIVEWAYS.

WINNETT COUNTY TRAFFIC CALMING DESIGN GUIDE
 LOW SPEED CURVE
 NOT TO SCALE
 APRIL 2008
 DRAWING NO. TC-02

Martenson & Eisele, Inc.



1377 Midway Road
 Menasha, WI 54952
 www.martenson-eisele.com
 info@martenson-eisele.com
 920.731.0381 1.800.236.0381



Planning
 Environmental
 Surveying
 Engineering
 Architecture

LOW SPEED CURVE



FIELD BK	PAGE	DRAWN BY EAE	CHECKED	APPROVED	DRAWING NO.
SCALE N.T.S.	DATE 11/20/07	NO.	DATE	REVISION	
COMPUTER FILE					
TrafficCalming06CAD.dwg					

S.27

SIGN DESCRIPTION:
 R1-2 YIELD
 OM-3L OBJECT MARKER
 W2-6 CIRCULAR INTERSECTION
 W3-1 ADVISORY SPEED (15 MPH)

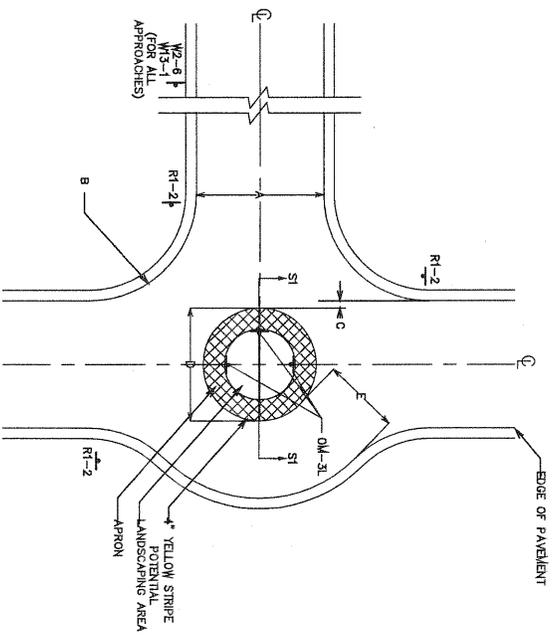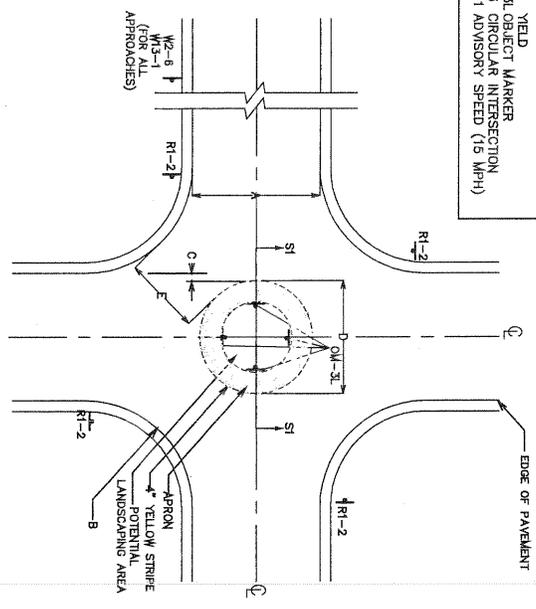

NOTE: 1. TRAFFIC CIRCLES SHALL BE USED ONLY IF ALTERNATE ROUTES ARE PROVIDED TO ALL GENERATORS BEYOND TRAFFIC CIRCLES.
 2. DRIVEWAYS SHALL NOT BE LOCATED WITHIN 20' OF TRAFFIC CIRCLE.

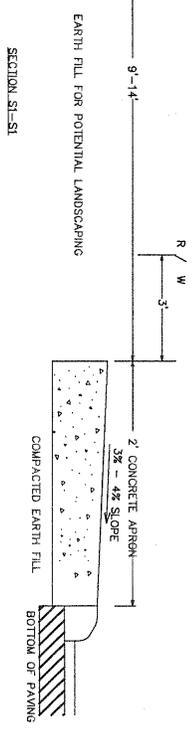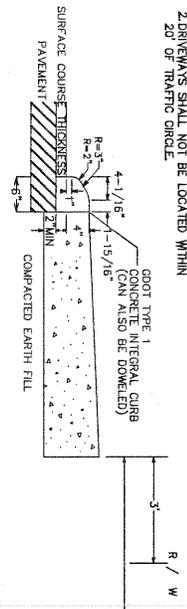

MINNETT COUNTY TRAFFIC CALMING DESIGN GUIDE
 TRAFFIC CIRCLE INSTALLATION DETAILS
 DRAWING NO. TC-03
 APRIL 2006

NOT TO SCALE

Martenson & Eisele, Inc.
 1377 Midway Road
 Menasha, WI 54952
 www.martenson-eisele.com
 info@martenson-eisele.com
 920.731.0381 1.800.236.0381


Planning
 Environmental
 Surveying
 Engineering
 Architecture

TRAFFIC CIRCLE INSTALLATION
 DETAILS



FIELD BK	PAGE	DRAWN BY EAE	CHECKED	APPROVED	DRAWING NO.
SCALE N.T.S.	DATE 11/20/07	NO.	DATE	REVISION	
COMPUTER FILE					
TrafficCalming06CAD.dwg					

STREET WIDTH (FEET)	CURB RETURN RADIUS (FEET)	OFFSET DISTANCE (FEET)	CIRCLE DIAMETER (FEET)	OPENING WIDTH (FEET)
A	B	C	D	E
19'	30' MIN.	2.5'	14'	18'
21'	30' MIN.	2.5'	16'	19'
23'	25'	2.5'	18'	18'
	30'	2.0'	19'	19'

TRAFFIC CIRCLE DIMENSIONS

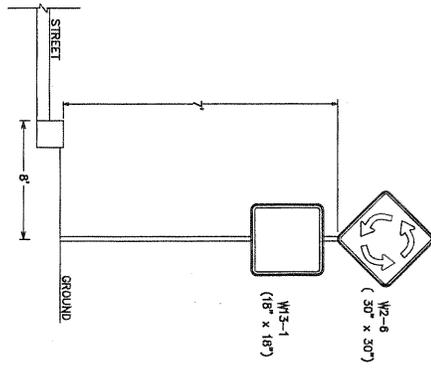

TYPICAL SIGNAGE INSTALLATION

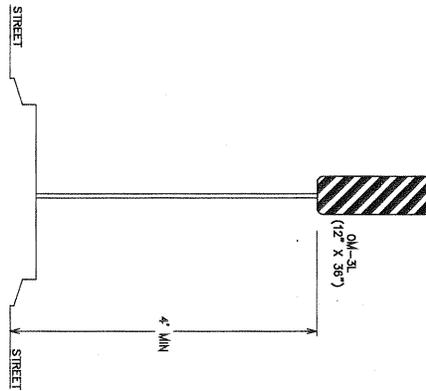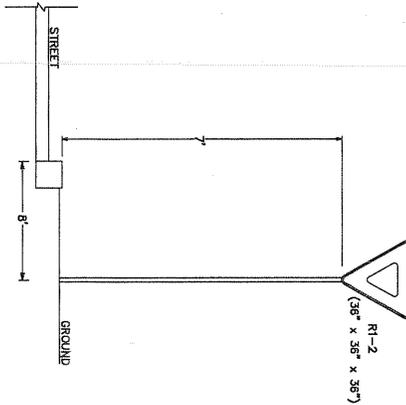

S.28

CHANNETT COUNTY TRAFFIC CALMING DESIGN GUIDE
TRAFFIC CIRCLE SIGNAGE
DRAWING NO. TC-04

NOT TO SCALE

Martenson & Eisele, Inc.

1377 Midway Road
Menasha, WI 54952
www.martenson-eisele.com
info@martenson-eisele.com
920.731.0381 1.800.236.0381

Planning
Environmental
Surveying
Engineering
Architecture




TRAFFIC CIRCLE SIGNAGE

FIELD BK	PAGE	NO.	DATE	REVISION	DRAWING NO.
SCALE N.T.S.	DATE 11/20/07				
COMPUTER FILE					
TrafficCalming66CAD.dwg					

S.29





SIGN DESCRIPTION:
OM-3L OBJECT MARKER

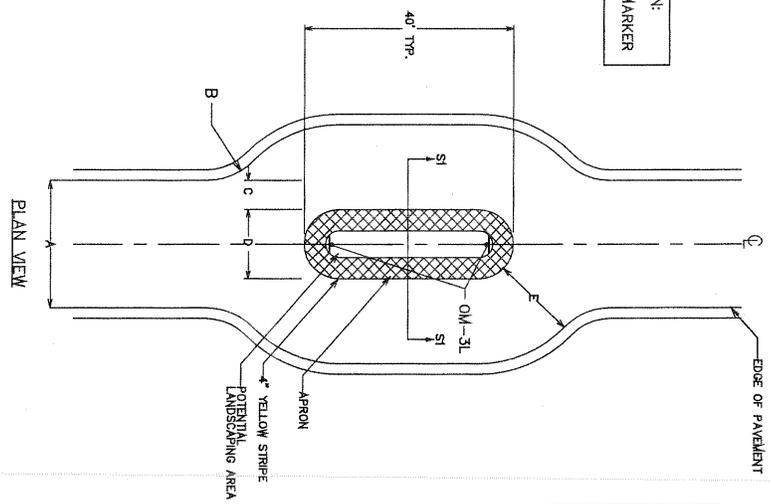

MEDIAN ISLAND (OPTION 1) DIMENSIONS

STREET WIDTH (CURB RETURN) (FEET)	RADIUS (FEET)	OFFSET DISTANCE (FEET)	CIRCLE DIAMETER (FEET)	OPENING WIDTH (FEET)
A	B	C	D	E
18'	20' (MIN)	5.0'	9'	16'
	20' (MAX)	4.0'	11'	17'
21'	20' (MIN)	6.0'	11'	16'
	20' (MAX)	4.0'	13'	17'
23'	20' (MIN)	8.0'	13'	16'
	20' (MAX)	4.0'	15'	17'

NOTE: 1. DRAWINGS SHALL NOT BE LOCATED WITHIN 20' OF MEDIAN ISLAND.

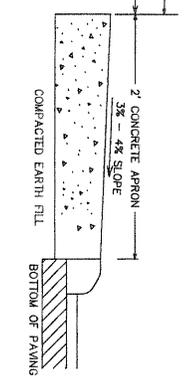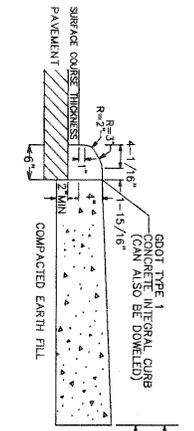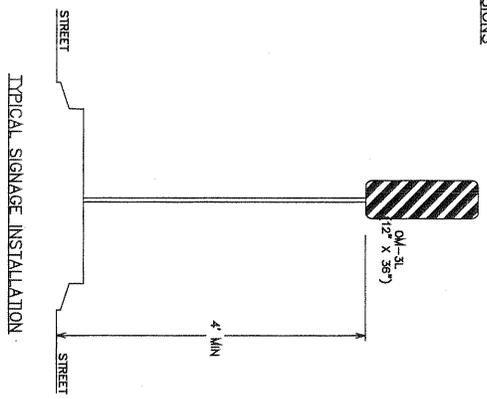


MINNETT COUNTY TRAFFIC CALMING DESIGN GUIDE
MEDIAN ISLAND INSTALLATION DETAILS AND SIGNAGE (OPTION 1)
NOT TO SCALE
APRIL 2006
DRAWING NO. TC-05

MEDIAN ISLAND INSTALLATION DETAILS AND SIGNAGE (OPTION 1)

FIELD BK	PAGE	DRAWN BY	CHECKED	APPROVED	DRAWING NO.
		EAE			
SCALE	DATE	NO.	DATE	REVISION	
N.T.S.	11/20/07				
COMPUTER FILE					
TrafficCalming06CAD.dwg					





Martenson & Eisele, Inc.
1377 Midway Road
Menasha, WI 54952
www.martenson-eisele.com
info@martenson-eisele.com
920.731.0381 1.800.236.0381
Planning
Environmental
Surveying
Engineering
Architecture

SIGN DESCRIPTION:
 OM-3L OBJECT MARKER
 R1-1 STOP

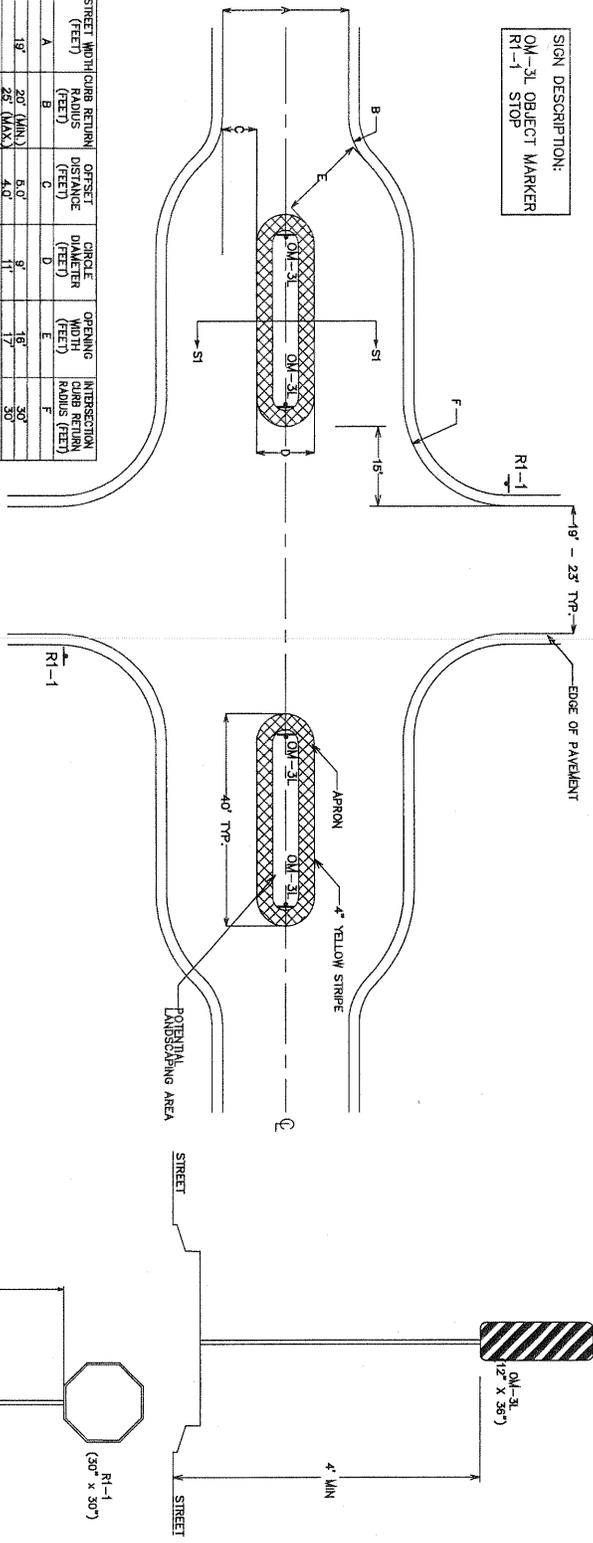

STREET WIDTH (CURB RETURN) (FEET)	STREET WIDTH (FEET)	STREET WIDTH (FEET)	CIRCLE DIAMETER (FEET)	CIRCLE DIAMETER (FEET)	OPENING WIDTH (FEET)	INTERSECTION CLEARANCE RADIUS (FEET)
A	B	C	D	E	F	F
18'	20' (MIN.)	6.0'	9'	16'	30'	30'
20'	26' (MAX.)	4.0'	11'	17'	30'	30'
21'	20' (MIN.)	5.0'	11'	16'	30'	30'
25'	25' (MAX.)	4.0'	13'	17'	30'	30'
25'	20' (MIN.)	5.0'	13'	16'	30'	30'
26'	26' (MIN.)	4.0'	15'	17'	30'	30'

NOTE: 1. ENSURE INTERSECTION SIGHT DISTANCE IS MAINTAINED.
 2. MEDIAN ISLANDS SHALL BE USED AT INTERSECTIONS ONLY IF ALTERNATE ROUTES ARE PROVIDED TO ALL GENERATORS BEYOND THESE MEDIAN ISLANDS.
 3. DRIVERS SHALL NOT BE LOCATED WITHIN 20' OF MEDIAN ISLAND.

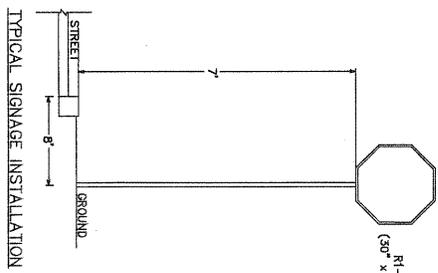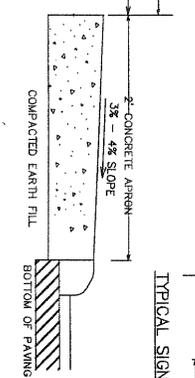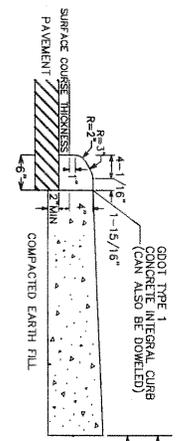

S.30

MINNETT COUNTY TRAFFIC CALMING DESIGN GUIDE
 MEDIAN ISLAND INSTALLATION DETAILS AND SIGNAGE (OPTION 1)
 AT INTERSECTIONS
 DRAWING NO. TC-05A
 APRIL 2006

NOT TO SCALE

Martenson & Eisele, Inc.



1377 Midway Road
 Menasha, WI 54952
 www.martenson-eisele.com
 info@martenson-eisele.com
 920.731.0381 1.800.236.0381

Planning
 Environmental
 Surveying
 Engineering
 Architecture

MEDIAN ISLAND INSTALLATION DETAILS AND SIGNAGE (OPTION 1) AT INTERSECTIONS




FIELD BK	PAGE	DRAWN BY	CHECKED	APPROVED	DRAWING NO.
		EAE			
SCALE	DATE	NO.	DATE	REVISION	
N.T.S.	11/20/07				
COMPUTER FILE					
TrafficCalming06CAD.dwg					

S.31

NOTE: 1. DRIVEWAYS SHALL NOT BE LOCATED WITHIN 20' OF MEDIAN ISLAND.

STREET WIDTH (FEET)	CURB RETURN RADIUS (FEET)	OUTER RADIUS OF ROADWAY (FEET)	RADIUS OF ISLAND (FEET)	OPENING WIDTH (FEET)
A	B	C	D	E
19	35 MIN	53	37	16
21	25 MIN	58	37	17
23	15 MIN	58	37	18

MEDIAN ISLAND (OPTION 2) DIMENSIONS

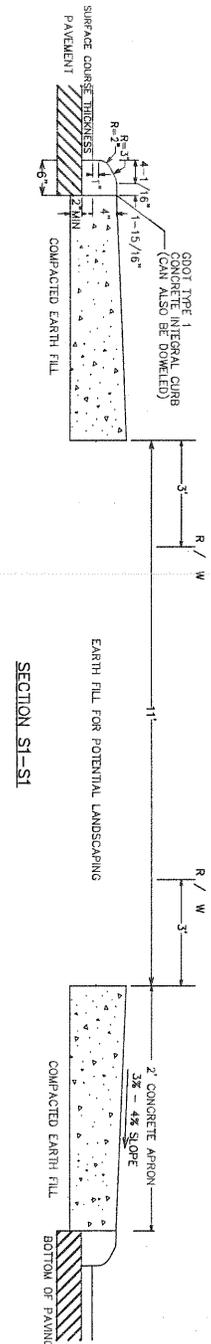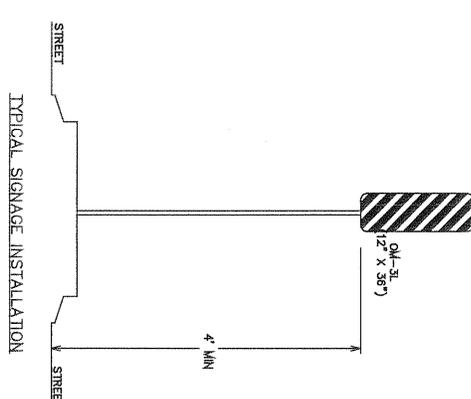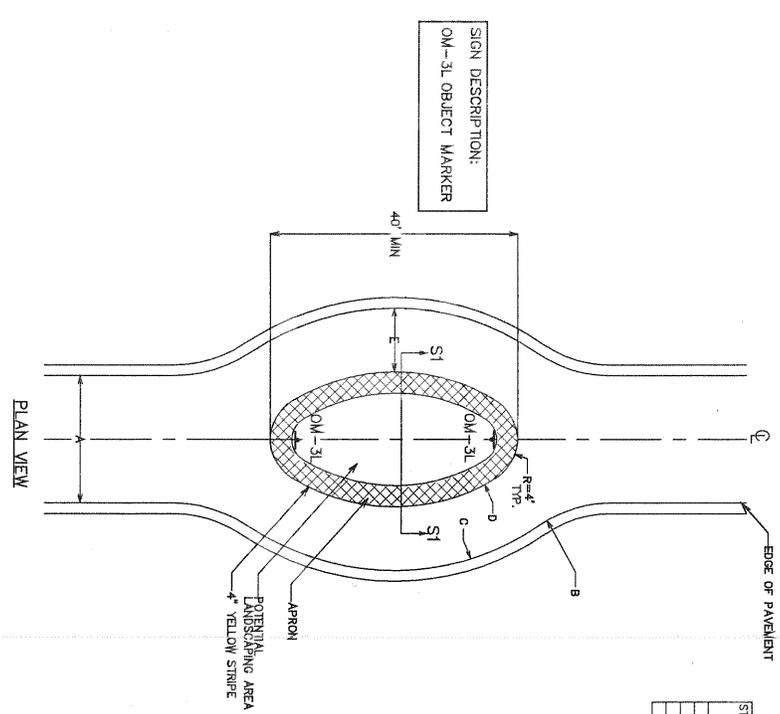

MINNETT COUNTY TRAFFIC CALMING DESIGN GUIDE
 MEDIAN ISLAND INSTALLATION DETAILS AND SIGNAGE (OPTION 2)
 DRAWING NO. TC-06
 APRIL 2006
 NOT TO SCALE


Martenson & Eisele, Inc.
 1377 Midway Road
 Menasha, WI 54952
 www.martenson-eisele.com
 info@martenson-eisele.com
 920.731.0381 1.800.236.0381
 Planning
 Environmental
 Surveying
 Engineering
 Architecture

MEDIAN ISLAND INSTALLATION DETAILS AND SIGNAGE (OPTION 2)


FIELD BK	PAGE	DRAWN BY	CHECKED	APPROVED	DRAWING NO.
		EAE			
SCALE	DATE	NO.	DATE	REVISION	
N.T.S.	11/2007				
COMPUTER FILE					
TrafficCalming06CAD.dwg					

S.32


SIGN DESCRIPTION:
 R1-2 YIELD
 W2-6 CIRCULAR INTERSECTION
 W3-1 ADVISORY SPEED (16 MPH)
 W5-24 YIELD AHEAD
 W1-6 ONE DIRECTION LARGE ARROW

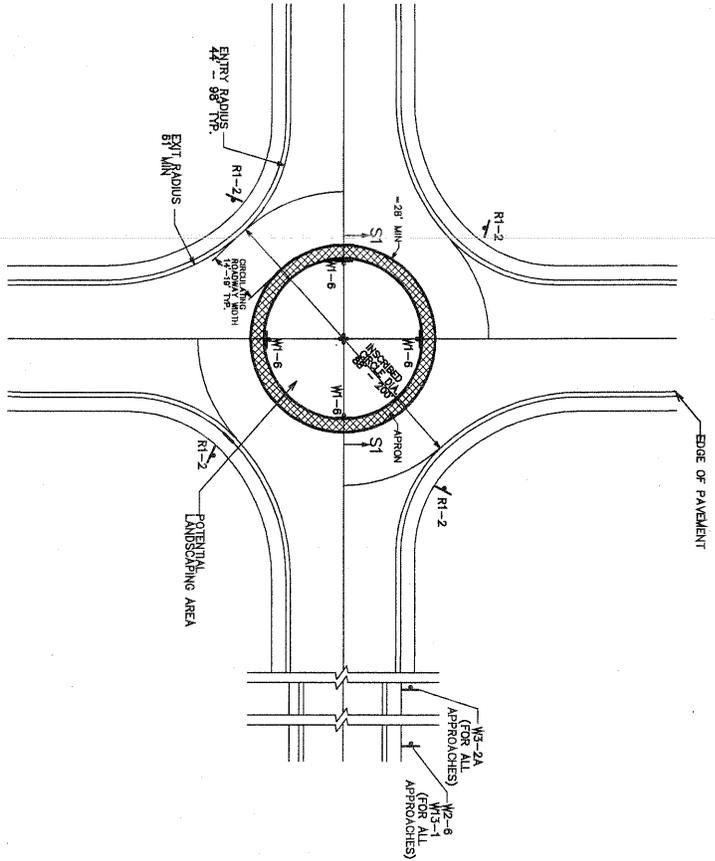

NOTE 1: DRIVERS SHALL NOT BE LOCATED WITHIN THE APRON.
 2: ROUNDABOUT DESIGN SHOULD FOLLOW THE GUIDELINES PRESENTED IN ROUNDABOUT: AN INFORMATIONAL GUIDE, US DEPARTMENT OF TRANSPORTATION, FEDERAL HIGHWAY ADMINISTRATION, PUBLICATION NO. FHWA-90-30-907.

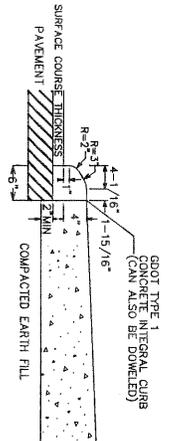

SECTION S1-S1

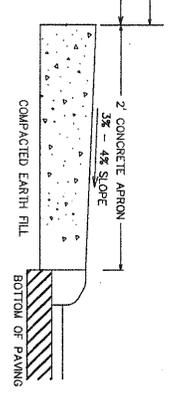

PLAN VIEW

MINNETT COUNTY TRAFFIC CALMING DESIGN GUIDE
 ROUNDABOUT INSTALLATION DETAILS
 DRAWING NO. TC-07
 APRIL 2006
 NOT TO SCALE



ROUNDABOUT INSTALLATION DETAILS

FIELD BK	PAGE	DRAWN BY	CHECKED	APPROVED	DRAWING NO.
		EAE			
SCALE	DATE	NO.	DATE	REVISION	
N.T.S.	11/20/07				
COMPUTER FILE					
TrafficCalming06CAD.dwg					

Martenson & Eisele, Inc.
 1377 Midway Road
 Menasha, WI 54952
 www.martenson-eisele.com
 info@martenson-eisele.com
 920.731.0381 1.800.236.0381

Planning
 Environmental
 Surveying
 Engineering
 Architecture



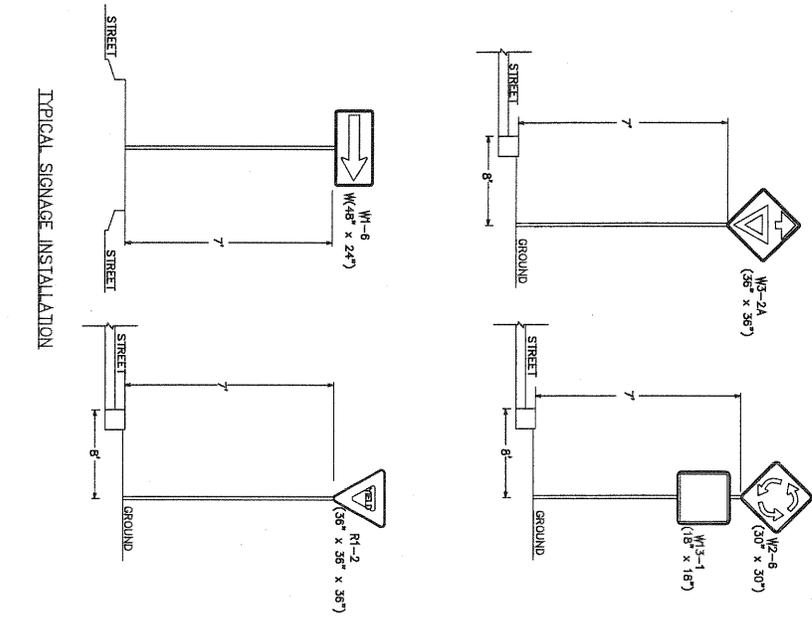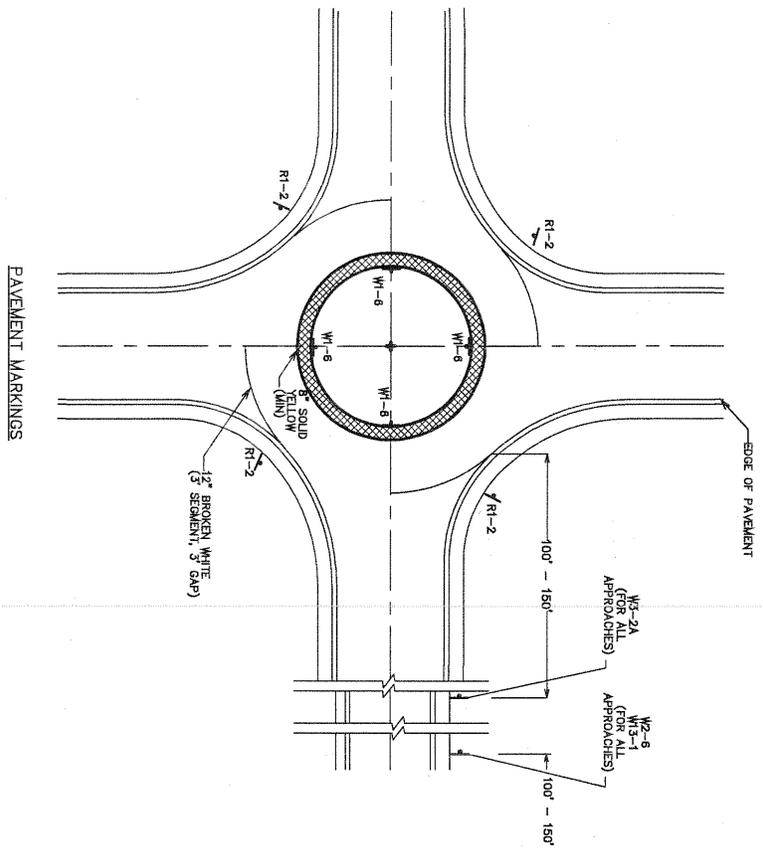

S.33

WINNEBAGO COUNTY TRAFFIC CALMING DESIGN GUIDE
 ROUNDABOUT MARKINGS AND SIGNAGE
 APRIL 2008
 DRAWING NO. TC-08

Martenson & Eisele, Inc.
 1377 Midway Road
 Menasha, WI 54952
 www.martenson-eisele.com
 info@martenson-eisele.com
 920.731.0381 1.800.236.0381


Planning
 Environmental
 Surveying
 Engineering
 Architecture

ROUNDABOUT MARKINGS AND SIGNAGE

FIELD BK	PAGE	DRAWN BY	CHECKED	APPROVED	DRAWING NO.
		EAE			
SCALE	DATE	NO.	DATE	REVISION	
N.T.S.	11/20/07				
COMPUTER FILE					
T:\TrafficCalming\06CAD.dwg					

S.34





DESCRIPTION:
OM-3L OBJECT MARKER

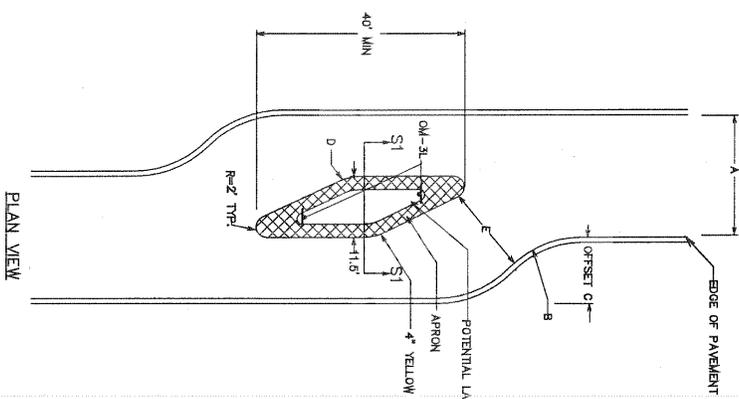

LATERAL SHIFT DIMENSIONS

STREET WIDTH CURB RETURN (FEET)	RADIUS (FEET)	OFFSET DISTANCE (FEET)	ROADWAY RADIUS (FEET)	OPENING WIDTH (FEET)
A	B	C	D	E
17	19.5	NOT RECOMMENDED	NOT RECOMMENDED	18.5
23	19.5	11.5	10	18.5

NOTE: 1. DRIVEWAYS SHALL NOT BE LOCATED WITHIN 20' OF LATERAL SHIFT.

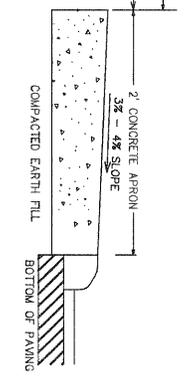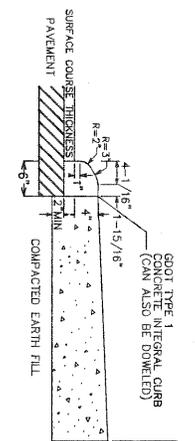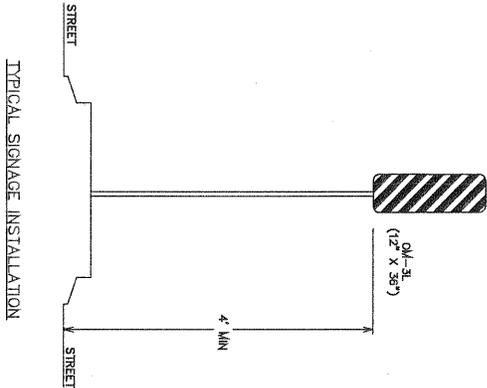

MINNETT COUNTY TRAFFIC CALMING DESIGN GUIDE
TYPICAL LATERAL SHIFT INSTALLATION DETAILS AND SIGNAGE
NOT TO SCALE
DRAWING NO. TC-09
APRIL 2008

Martenson & Eisele, Inc.
1377 Midway Road
Menasha, WI 54952
www.martenson-eisele.com
info@martenson-eisele.com
920.731.0381 1.800.236.0381

Planning
Environmental
Surveying
Engineering
Architecture





TYPICAL LATERAL SHIFT
INSTALLATION DETAILS AND SIGNAGE

FIELD BK	PAGE	DRAWN BY EAE	CHECKED	APPROVED	DRAWING NO.
SCALE N.T.S.	DATE 11/20/07	NO.	DATE	REVISION	
COMPUTER FILE TrafficCalming06CAD.dwg					

S.36


RAISED CROSSWALK INSTALLATION DETAILS

FIELD BK	PAGE	DRAWN BY	CHECKED	APPROVED	DRAWING NO.
		EAE			
SCALE	DATE	NO.	DATE	REVISION	
N.T.S.	11/20/07				
COMPUTER FILE					
TrafficCalming06CAD.dwg					

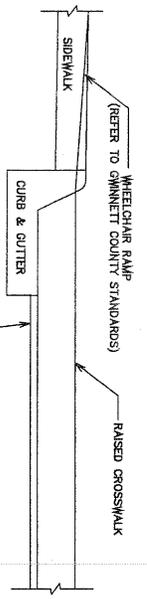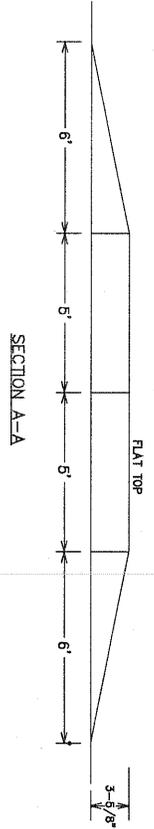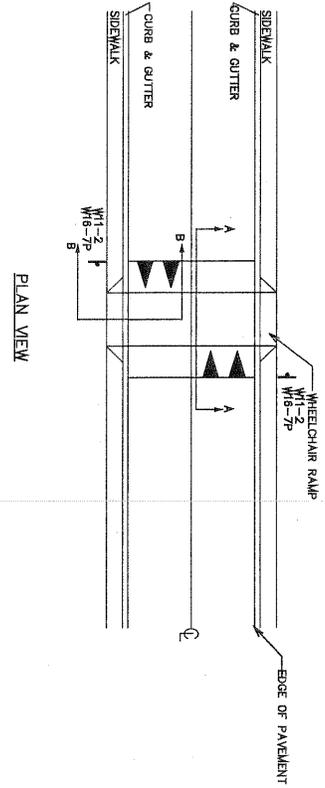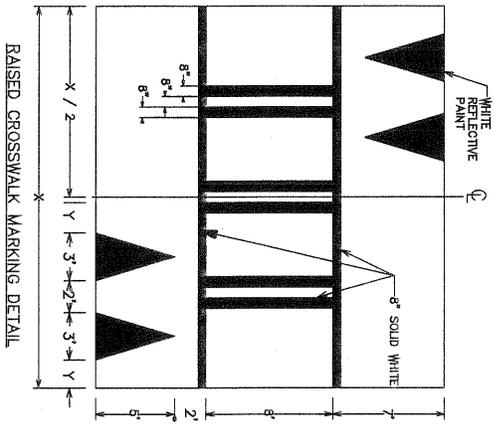

SIGN DESCRIPTION:
 W1-2 PEDESTRIAN
 W16-7P DIAGONAL ARROW

NOTES: 1. PROP. INLETS ARE REQUIRED ON THE UPHILL SIDE OF THE RAISED CROSSWALK FOR DRAINAGE PURPOSES.
 2. DRIVEWAYS SHALL NOT BE LOCATED WITHIN 20' OF RAISED CROSSWALK.

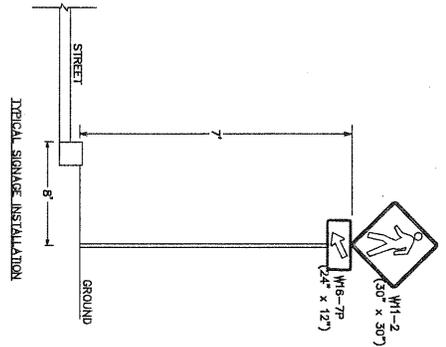

GWINNETT COUNTY TRAFFIC CALMING DESIGN GUIDE
 RAISED CROSSWALK INSTALLATION DETAILS
 DRAWING NO. TC-11
 APRIL 2006
 NOT TO SCALE


Martenson & Eisele, Inc.




1377 Midway Road
 Menasha, WI 54952
 www.martenson-eisele.com
 info@martenson-eisele.com
 920.731.0381 1.800.236.0381

Planning
 Environmental
 Surveying
 Engineering
 Architecture


S.37

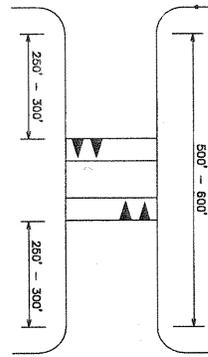


ONE DEVICE - SINGLE SHORT LENGTH TANGENT

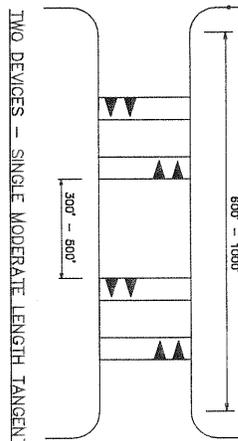


TWO DEVICES - SINGLE MODERATE LENGTH TANGENT

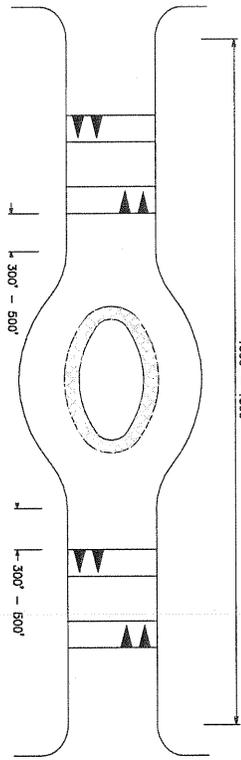

THREE DEVICES - SINGLE LONG LENGTH TANGENT

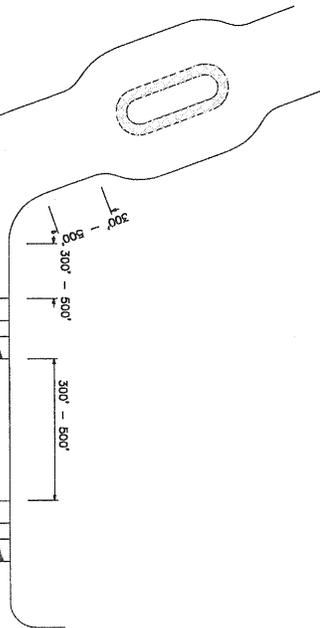

MULTIPLE DEVICES - SINGLE LONG LENGTH TANGENT

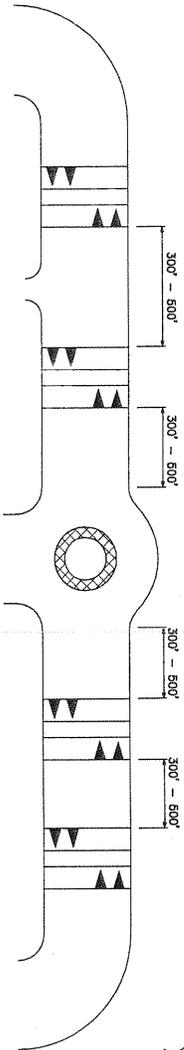

MULTIPLE DEVICES - SINGLE LONG LENGTH TANGENT

NOTES: 1. FOR MULTI-BLOCK SEGMENTS, AT LEAST ONE DEVICE PER BLOCK.
 FOLLOW SPACING CONCEPTS ABOVE WITHIN EACH COMPONENT BLOCK. MAXIMUM AND MINIMUM SEPARATION AND "FIRST DEVICE" CRITERIA MAY BE RELAXED SOMEWHAT TO CONFORM TO PARTICULAR SITE CONDITIONS.

MINNETT COUNTY TRAFFIC CALMING DESIGN GUIDE
 SPACING OF TRAFFIC CALMING DEVICES
 APRIL 2006
 DRAWING NO. TC-12

NOT TO SCALE

Martenson & Eisele, Inc.



1377 Midway Road
 Menasha, WI 54952
 www.martenson-eisele.com
 info@martenson-eisele.com
 920.731.0381 1.800.236.0381


Planning
 Environmental
 Surveying
 Engineering
 Architecture

SPACING OF TRAFFIC CALMING DEVICES

FIELD BK	PAGE	DRAWN BY	CHECKED	APPROVED	DRAWING NO.
SCALE	DATE	NO.	DATE	REVISION	
COMPUTER FILE					
TrafficCalming06CAD.dwg					


Cul-de-Sac < 250 ft.

Figure 1

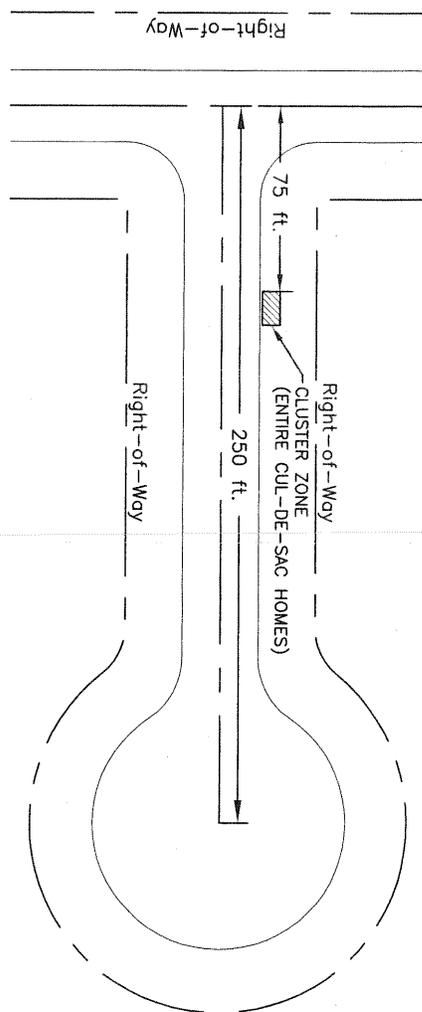

Cul-de-Sac > 250 ft.

Figure 2

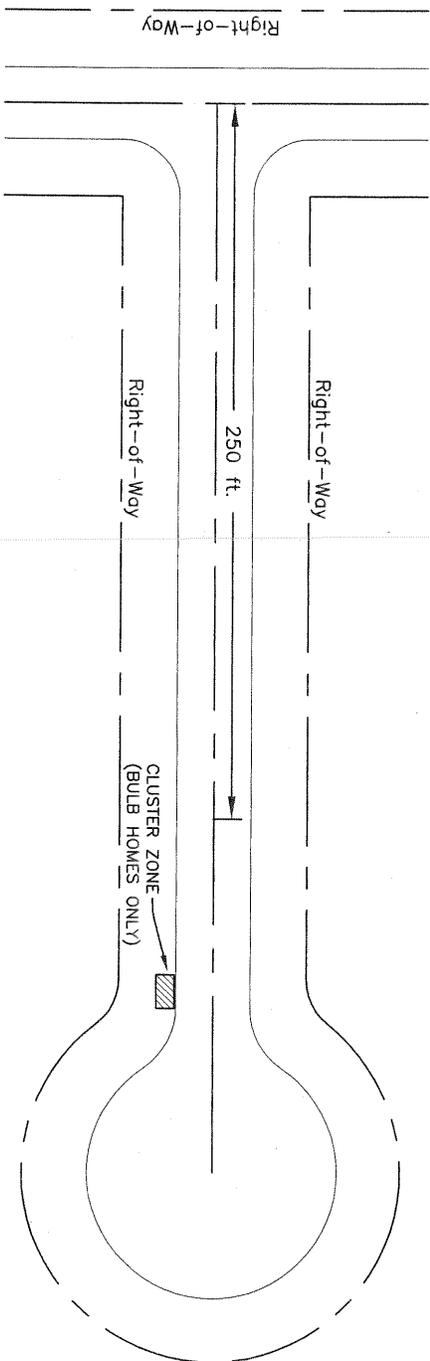

S.38

Martenson & Eisele, Inc.



1377 Midway Road
Menasha, WI 54952
www.martenson-eisele.com
info@martenson-eisele.com
920.731.0381 1.800.236.0381

Planning
Environmental
Surveying
Engineering
Architecture

CLUSTER MAIL BOXES

FIELD BK	PAGE		DRAWN BY EAE	CHECKED	APPROVED	DRAWING NO.
SCALE N.T.S.	DATE 12/15/08	NO.	DATE	REVISION		
COMPUTER FILE CLUSTER MAIL BOXES.dwg						